

AMERICAN NATIONAL STANDARD

ANSI/NAAMM **MBG 532-00**

GRATINGS

**5**

**000**

ANSI/NAAMM MBG 532-00  
November 14, 2000



مجتمع تولیدی صنعتی ام پیکو

طراح و سازنده انواع گریتینگ

# HEAVY DUTY METAL BAR GRATING MANUAL

FOURTH EDITION

ANSI/NAAMM MBG 532-00  
November 14, 2000

**000**

**5**

GRATINGS

**MBG** Metal Bar Grating Division of

THE NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS

**NAAMM**

Approval of an American National Standard requires verification by ANSI that the requirements for due process, consensus, and other criteria for approval have been met by the standards developer.

Consensus is established when, in the judgment of the ANSI Board of Standards Review, substantial agreement has been reached by directly and materially affected interests. Substantial agreement means much more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that a concerted effort be made toward their resolution.

The use of American National Standards is completely voluntary; their existence does not in any respect preclude anyone, whether he has approved the standards or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standards.

The American National Standards Institute does not develop standards and will in no circumstances give an interpretation of any American National Standard. Moreover, no person shall have the right or authority to issue an interpretation of an American National Standard in the name of the American National Standards Institute. Requests for interpretation should be addressed to the sponsor whose name appears on the title page of this standard.

**CAUTION NOTICE:** This American National Standard may be revised or withdrawn at any time. The procedures of the American National Standards Institute require that action be taken periodically to reaffirm, revise, or withdraw this standard. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute.

This standard was developed by representative members of the Metal Bar Grating Division (MBG) of the National Association of Architectural Metal Manufacturers (NAAMM) to provide their opinion and guidance on the specification and use of metal bar gratings. This standard contains advisory information only and is published as a public service by NAAMM. NAAMM and its Divisions disclaim all liability of any kind for the use, application, or adaptation of material published in this standard.

*Current information on all NAAMM Standards is available by calling or writing the National Association of Architectural Metal Manufacturers or by going to [www.naamm.org](http://www.naamm.org).*

# HEAVY DUTY METAL BAR GRATING MANUAL

*For Structural Carbon Steel and Stainless Steel*

Fourth Edition

ANSI/NAAMM MBG 532-00

- Maximum Bearing Bar Depth ..... 5" (127mm)
- Bearing Bar Thickness
  - Maximum ..... 3/8" (9.5mm)
  - Minimum ..... 1/4" (6.4mm)

Published and distributed by the

**NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS**

8 SOUTH MICHIGAN AVENUE . . .

CHICAGO, ILLINOIS 60603

## **NAAMM'S METAL BAR GRATING DIVISION**



The members of the Metal Bar Grating Division of the National Association of Architectural Metal Manufacturers have supported the preparation of this Manual. All are producers and/or suppliers of products conforming to the standards and specifications contained herein. A copy of the Membership Roster of the Metal Bar Grating Division is available from NAAMM.

tal Bar Grating Manual provides architects and engineers with heavy duty bar gratings of structural carbon steel and stainless steel. Descriptions of the most frequently used types of gratings, their construction, dimensional standards, load tables giving allowable unit loads, concentrated loads for spans from one foot (305 mm) through eight feet (2440 mm), installation practices, specifications, code of standard practice and glossary. The information is concerned primarily with bar gratings capable of supporting heavy loads. Architects and engineers interested in lighter walkway gratings are referred to the current edition of NAAMM's Metal Bar Grating Manual. (ANSI/NAAMM MBG 531). The first three editions of the manual have been widely used by the design professions. In preparing this fourth edition, the Metal Bar Grating Division of NAAMM has reviewed its contents in detail and has made revisions to reflect current practices. NAAMM believes that the scope of this manual makes it an excellent reference source for those concerned with the design of structures incorporating heavy duty metal bar gratings. The load tables in this edition are based on the design formulas and procedures found in MBG 534, Metal Bar Grating Engineering Design Manual, which was developed to provide a clearer understanding of the procedures used in the design of grating. Also included are metric equivalents to reflect the current trend toward metrication as an aid to designers who must use the metric system. The system of metric measurement used is from IEEE/ASTM SI 10-1997, "Standard for Use of the International System of Units (SI): the Modern Metric System". **The values stated in inch-pound units are to be regarded as the standard.** This manual presents the common heavy duty gratings manufactured by NAAMM members. NAAMM recognizes the many special designs that embody the use of special steel shapes and/or larger structural members that are used under the same conditions. Because these designs are so varied, they are not covered in this publication but can be manufactured according to the principles within this manual. Consult the manufacturers of these specialty items for technical information.

---

# CONTENTS

Introduction .....	3
Some Typical Uses of Gratings .....	3
Standard Marking System .....	4
Standard Gratings .....	6
Cross Bars and Reticuline Bars .....	7
Anchoring Details .....	8
Installation Notes and Panel Dimensions .....	9
Installation Clearances .....	10
Manufacturing Tolerances .....	11
Welding of Toe Plates and Banding .....	12
Ordering Information .....	13
Specifications .....	14
Code of Practice .....	15
Load Tables for Welded and Riveted Heavy Duty Carbon Steel Gratings .....	19
Glossary of Terms .....	68

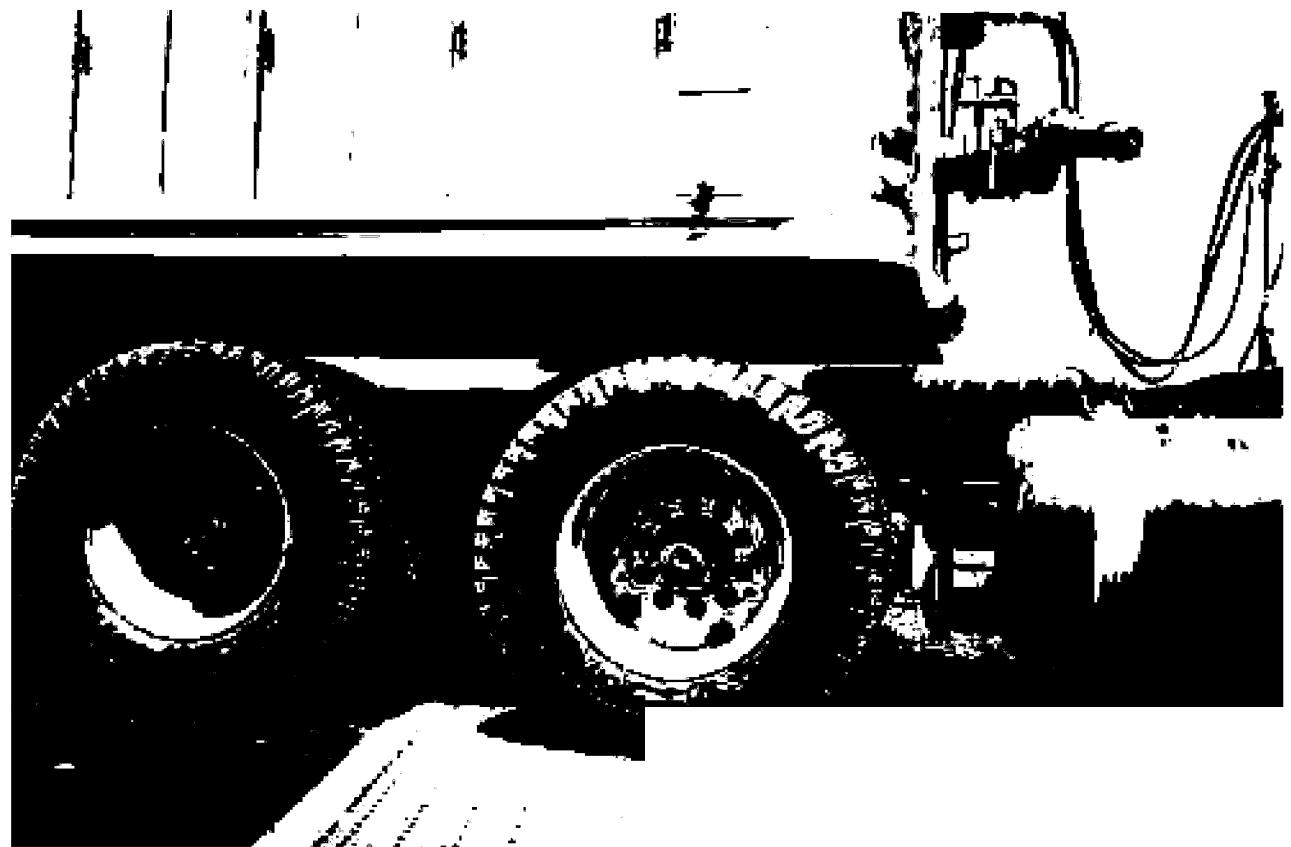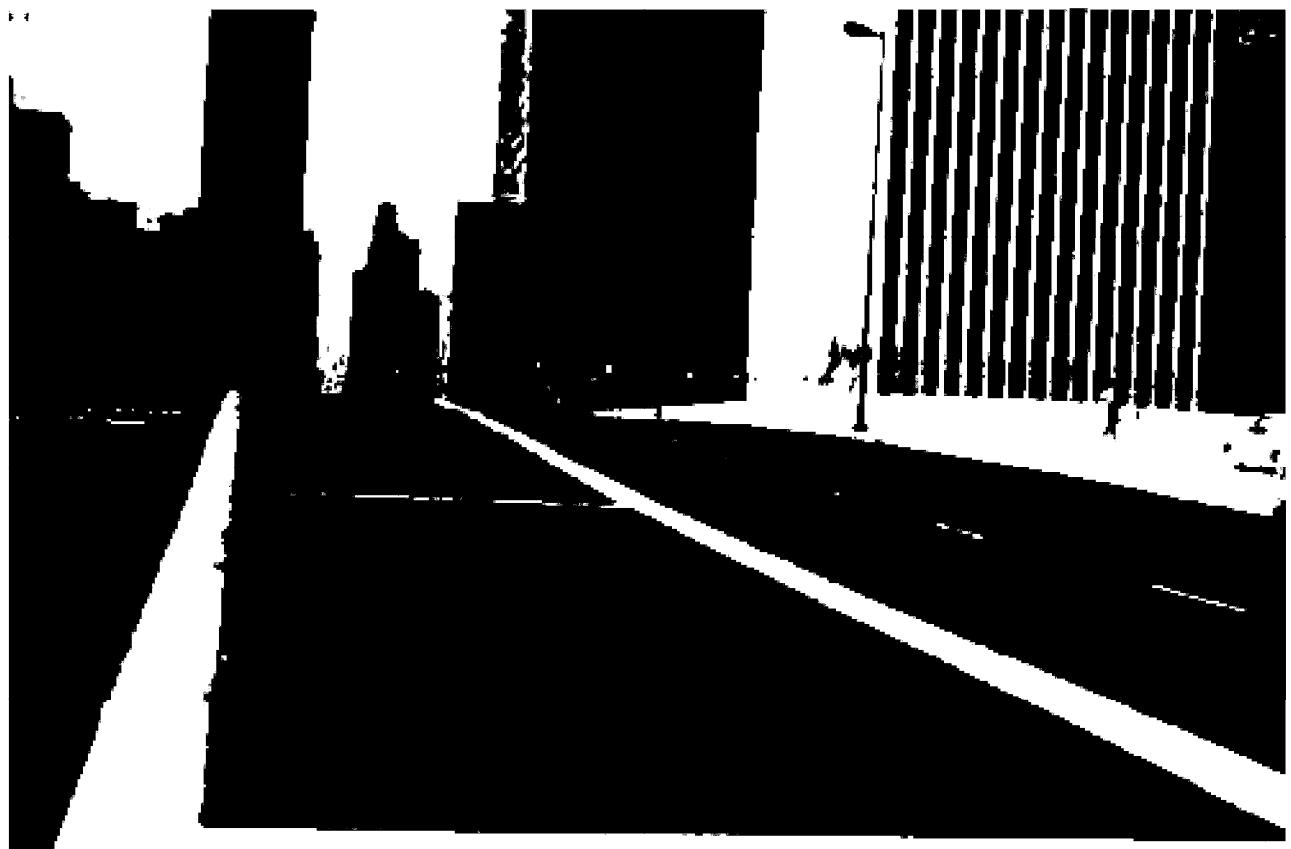

## N

y defined, are open grid assemblies of metal bars in which the bars run parallel in one direction and are spaced equidistant from attachment to cross bars running in a perpendicular direction, line bars extending between them.

There are three types of steel bar gratings – welded, pressure-locked, and riveted. Welded gratings are fabricated by joining bearing bars and cross bars at their intersections by welding. In pressure-locked gratings the cross bars are mechanically locked to the bearing bars by deforming the bars under tremendous hydraulic pressure. For riveted gratings the reticuline bars are joined to the bearing bars at their points of contact by riveting.

Metal bar gratings of all three types provide economical structures with high strength to weight ratios for use in many applications, a number of which are listed below. Relatively unrestricted passage of water, light, air, and heat are some of the features which make gratings not only desirable but essential in certain types of construction. Floor gratings permit immediate drainage of water from rain or other sources. They also simplify the ventilation and heating of certain types of industrial buildings.

Floor gratings are capable of supporting both pedestrian and vehicular traffic. Lighter weight gratings are satisfactory for pedestrian traffic; but, where heavy loads, including vehicular traffic, are involved, heavy duty metal bar gratings must be used. Heavy vehicular traffic is encountered in industrial plants with their heavy load carrying lift trucks and on highways and bridges with heavy trucks and tractor-trailers. The metal bar gratings described in this manual are used for these heavy duty applications. Note, however, that the load tables in this manual are based on allowable stresses for static loads. The effects of impact and fatigue shall be considered when designing metal bar grating for vehicular traffic.

Metal bar grating for bridge decking has some very specific advantages. Because of its light weight and simple installation, as compared with other surfaces, it permits resurfacing to handle heavier loads without the need for expensive sub-structure work. An additional advantage is that a municipality can carry a stock inventory of grating and replace a bridge surface quickly and economically.

Different applications impose different requirements on gratings. It is important, therefore, that the architect or engineer consult with the manufacturer in the selection of heavy duty metal bar gratings. The members of NAAMM who fabricate such gratings have many years of experience with many types of uses all over the country.

---

## SOME TYPICAL USES FOR GRATINGS

Airplane Landing Mats	Flooring	Pressure Vessel Internal Trays
Airplane Unloading Ramps	Fork Lift Traffic	Racks and Shelving
Animal Fences	Freight Car Flooring	Railway Crossings
Areaways	Highway Traffic	Ramps
Bar Screens	Hoppers	Stacked Parking Areas
Boat Landing Ramps	Machine and Motor Bases	Stage Supports
Bridge Centerline Markers	Machinery Safety Guards	Trap Doors
Bridge Flooring	Machinery Support Trenches	Trash Racks
Bridge Sidewalks	Material Screens	Trench Covers
Cattle Guards	Mezzanine Floors	Truck Beds
Concrete Armoring	Missile Protection	Vault Covers
Concrete Reinforcement	Mooring Docks	Vehicular Traffic Support
Drainage Pit Covers	Parapet Screens	Wash Racks
Floor Boards	Partitions	Window Guards
	Platforms	

## STANDARD MARKING SYSTEM

The marking system described here correlates the various types of bar grating and correlates their individual markings.

The standard marking system for metal bar grating, as illustrated on the facing page, identifies five characteristics of the grating in the following order:

### 1 TYPE OF GRATING

The type of grating shall be indicated by a letter, as follows:

- W Welded
- P Pressure-locked
- R Riveted


(See Glossary for definitions of types)

### 2 BEARING BAR SPACING

Bearing bar spacing shall be designated by a number which indicates sixteenths of an inch.

For welded or pressure-locked grating this is the distance, in sixteenths of an inch, **center to center** of bars.

For riveted grating it is the distance, in sixteenths of an inch, **between bearing bar faces**.

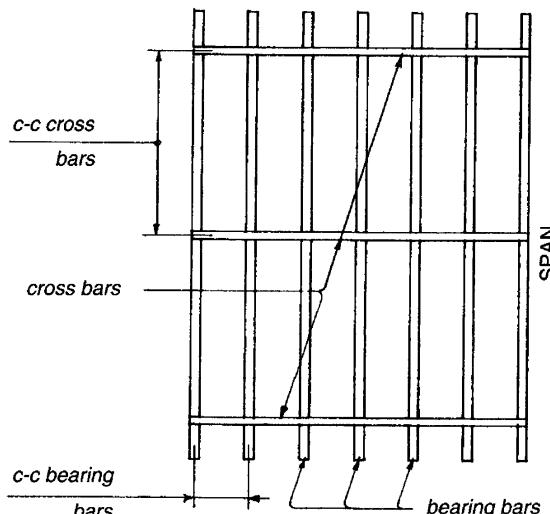

### 3 CROSS BAR OR RIVET SPACING

Cross bar or rivet spacing shall be designated by a number which indicates inches.

For welded or pressure-locked grating this is the distance, in inches, center to center of cross bars. For riveted grating it is the distance in inches center to center of rivets, measured along a single bearing bar.

In addition to spacings covered in this manual, consult individual manufacturers for other spacings available.


### 4 SIZE OF BEARING BARS

(COVERED IN THIS MANUAL)\*

The size of bearing bars shall be expressed in inches of depth and thicknesses as follows:

1 x 1/4	1-1/4 x 1/4	1-1/2 x 1/4	1-3/4 x 1/4
1 x 3/8	1-1/4 x 3/8	1-1/2 x 3/8	1-3/4 x 3/8
2 x 1/4	2-1/4 x 1/4	2-1/2 x 1/4	3 x 1/4
2 x 3/8	2-1/4 X 3/8	2-1/2 X 3/8	3 X 3/8
3-1/2 X 1/4	4 x 1/4	4-1/2 x 1/4	5 X 1/4
3-1/2 X 3/8	4 X 3/8	4-1/2 X 3/8	5 X 3/8

Note: The use of bearing bars larger than 5 x 3/8 is not addressed in this manual.

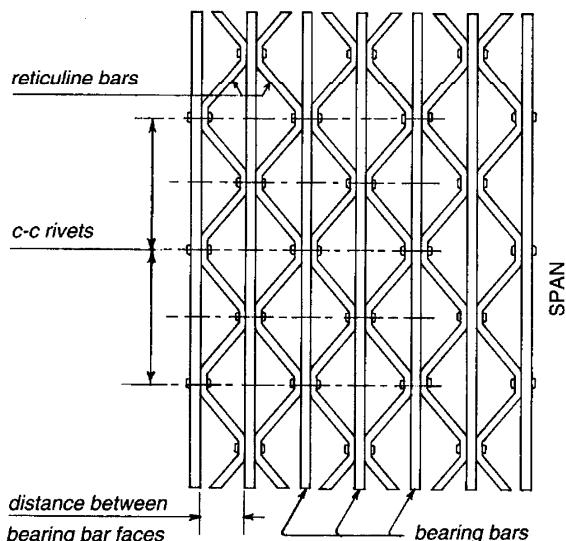

### 5 MATERIAL

Grating material shall be designated by name, such as "steel" or "stainless steel."

\*Equivalent bearing bar sizes in millimeters are obtained by a multiplication factor of 25.4.


### RIVETED GRATING

EXAMPLES OF  
USE OF STANDARD  
MARKING SYSTEM

DEFINITION OF GRATING DESIGNATED

	welded	
22	bearing bars spaced $1\frac{3}{8}$ in. (34.9 mm) on center	
4	cross bars spaced 4 in. (101.6 mm) on center	
(3 x $\frac{1}{4}$ )	bearing bar size, 3 in. x $\frac{1}{4}$ in. (76.2 mm x 6.4 mm)	
STEEL	material	
<b>P-38-4 (4 X <math>\frac{3}{8}</math>) STAINLESS STEEL</b>	<b>P</b>	pressure-locked
	38	bearing bars spaced $2\frac{3}{8}$ in. (60.3 mm) on center
	4	cross bars spaced 4 in. (101.6 mm) on center
	(4 x $\frac{3}{8}$ )	bearing bar size, 4 in. x $\frac{3}{8}$ in. (101.6 mm x 9.5 mm)
	STAINLESS	material
	STEEL	
<b>R-37-5 (3 X <math>\frac{1}{4}</math>) STEEL</b>	<b>R</b>	riveted
	37	bearing bars spaced $2\frac{5}{16}$ in. (58.7 mm) between faces
	5	rivets spaced 5 in. (127 mm) on center
	(3 x $\frac{1}{4}$ )	bearing bar size, 3 in. x $\frac{1}{4}$ in. (76.2 mm x 6.4 mm)
	STEEL	material

*NOTE: Any special requirements, such as reversible design or serrated bars, shall be additionally specified. Different bearing bar and cross bar spacings are available.*

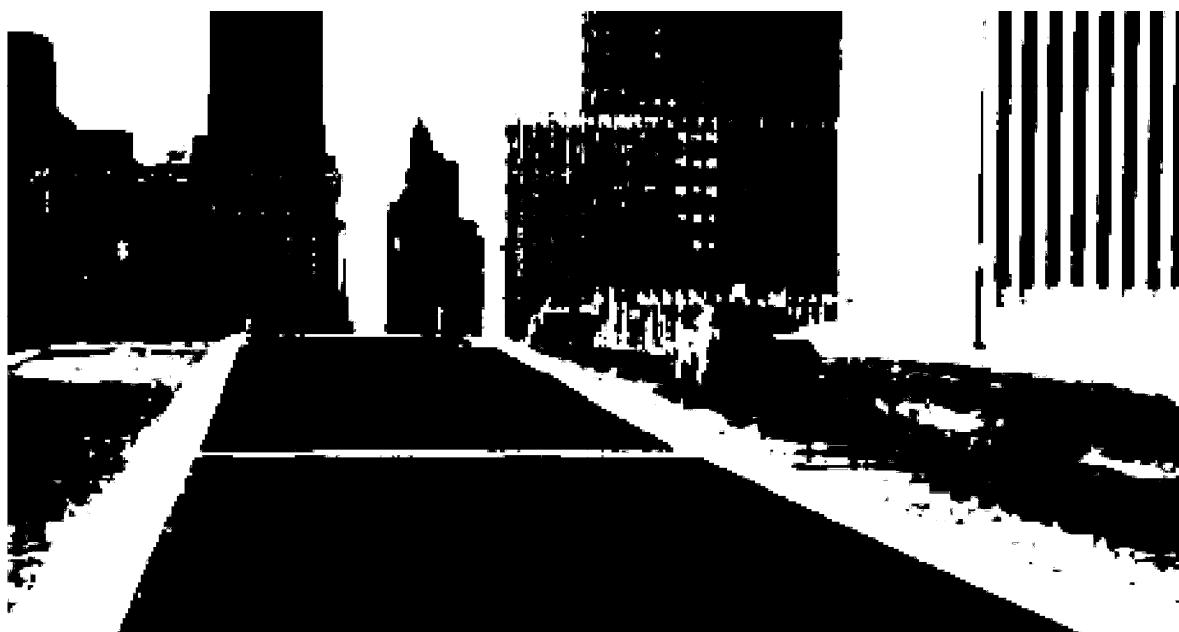


HEAVY DUTY WELDED GRATING

**STANDARD  
GRATINGS**



See GLOSSARY OF T  
*Welded, Pressure-locke*

**WELDED**  
Mark W-22-4

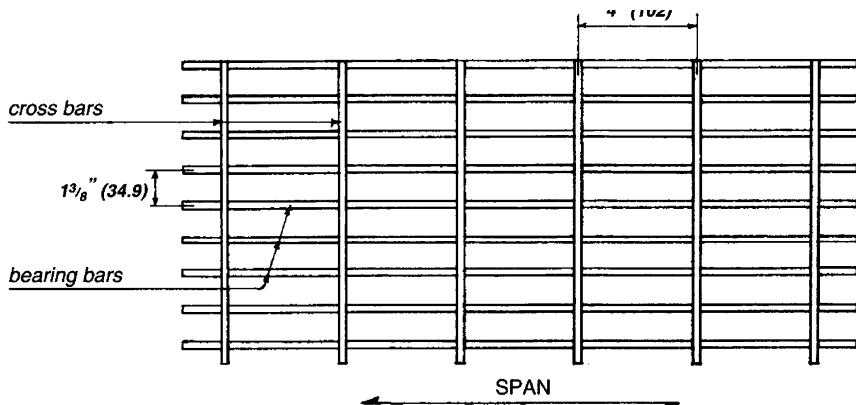



**PRESSURE-LOCKED**  
Mark P-38-4

Pressure-locked grating cross bars shall be welded to the first and last bearing bars.

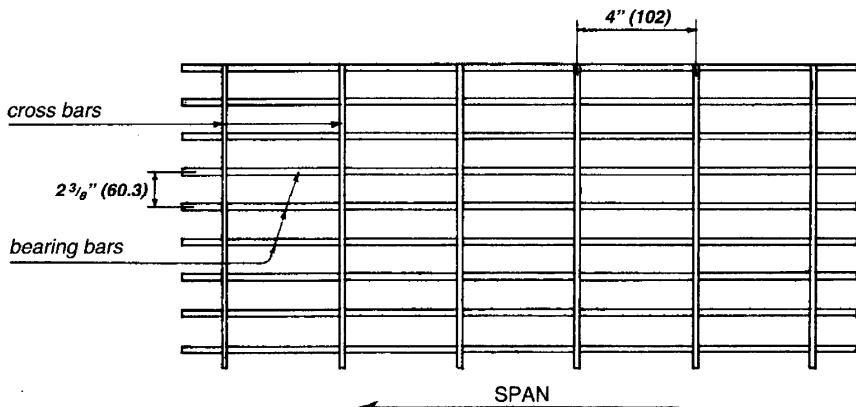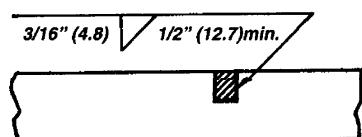

**RIVETED**  
Mark R-37-5\*

Riveted grating shall be furnished with either straight or crimped reticuline bars.

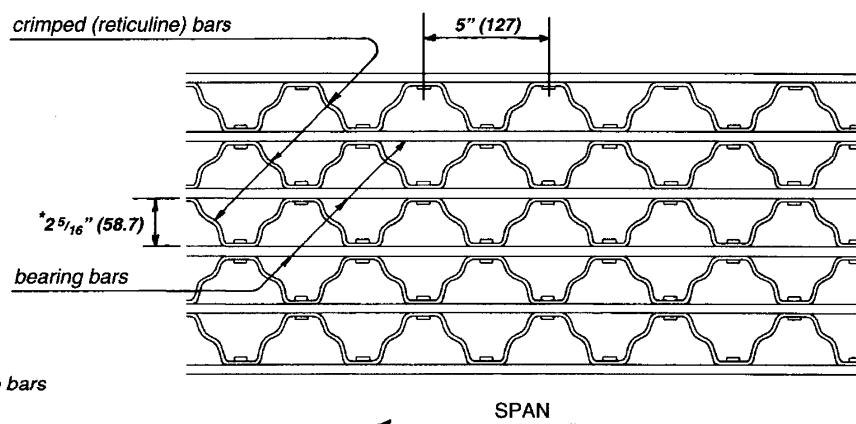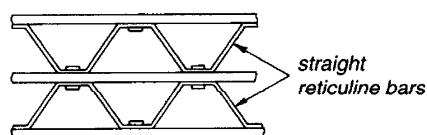

\*Note that riveted grating marking indicates space between bearing bars

## MINIMUM STANDARD SIZES

### CROSS BARS and RETICULINE BARS

All cross bars and reticuline bars shall be sized in accordance with reticuline bars shall be based on the type of grating system and the type grating systems shall comply with the minimum sizes given in Table No.1. Cross bars used in P type grating systems shall comply with the minimum sizes given in Table No. 2. Reticuline bars used in R type grating systems shall comply with Table No. 3.

**Table No. 1 — WELDED — (W)**

Bearing Bars			Cross Bars	
Thickness in. (mm)	Depth in. (mm)	Center to Center in. (mm)	Minimum Cross Sectional Area in. <sup>2</sup> (mm <sup>2</sup> )	
1/4 (6.4)	5 (127) or less	1 3/8 (34.9) or less	0.062 (40)	
1/4 (6.4)	5 (127) or less	more than 1 3/8 (34.9)	0.076 (49)	
3/8 (9.5)	2 1/2 (63.5) or less	1 3/8 (34.9) or less	0.085 (55)	
3/8 (9.5)	more than 2 1/2 (63.5)	all spacings	0.150 (97)	

**Table No. 2 — PRESSURE-LOCKED — (P)**

Bearing Bars		Cross Bars	
Thickness in. (mm)	Depth in. (mm)	Minimum Thickness in. (mm)	
1/4 (6.4)	2 (50.8) thru 5 (127)	3/16 (4.8)	
3/8 (9.5)	2 (50.8) thru 5 (127)	1/4 (6.4)	

**Table No. 3 — RIVETED — (R)**

Depth in. (mm)	Bearing Bars	Reticuline Bars	Rivets
	Minimum Size in. (mm)	Minimum Diameter in. (mm)	
1 (25.4)		3/4 x 3/16 (19 x 4.8)	1/4 (6.4)
1 1/4 (31.8) thru 2 1/4 (57.2)		1 x 3/16 (25.4 x 4.8)	1/4 (6.4)
2 1/2 (63.5) thru 3 1/2 (88.9)		1 1/4 x 3/16 (31.8 x 4.8)	3/8 (9.5)
4 (101.6) thru 5 (127)		1 1/2 x 3/16 (38.1 x 4.8)	3/8 (9.5)

Cross bars and reticuline bars shall provide the spacing and bracing for the bearing bars and are essential for the stabilization of the grating and the effective distribution of the load across the grating. The satisfactory performance of the grating is dependent on the integrity of the welded, pressure-locked or riveted joints and the use of cross bars or reticuline bars of a size adequate to perform their function.




HEAVY DUTY WELDED GRATING

## ANCHORING DETAILS

### IMPORTANT

Structural supports by positive means.

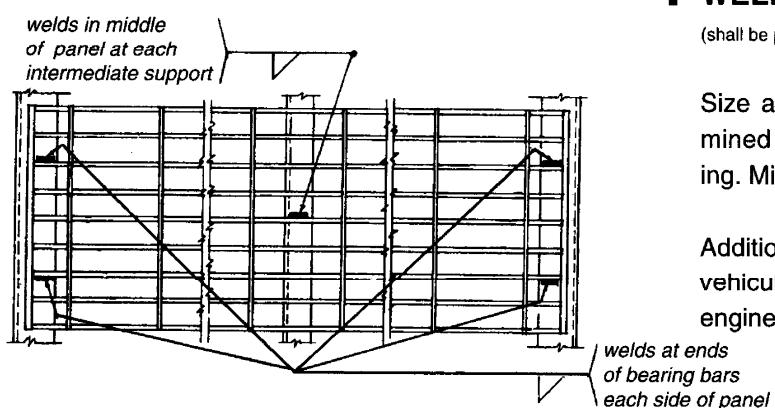


## 1 WELDED ANCHORAGE

(shall be performed by installing activity)

Size and pattern of welds shall be determined by application and/or size of grating. Minimum pattern shall be as shown.

Additional welding to supports required for vehicular traffic shall be considered by the engineer.

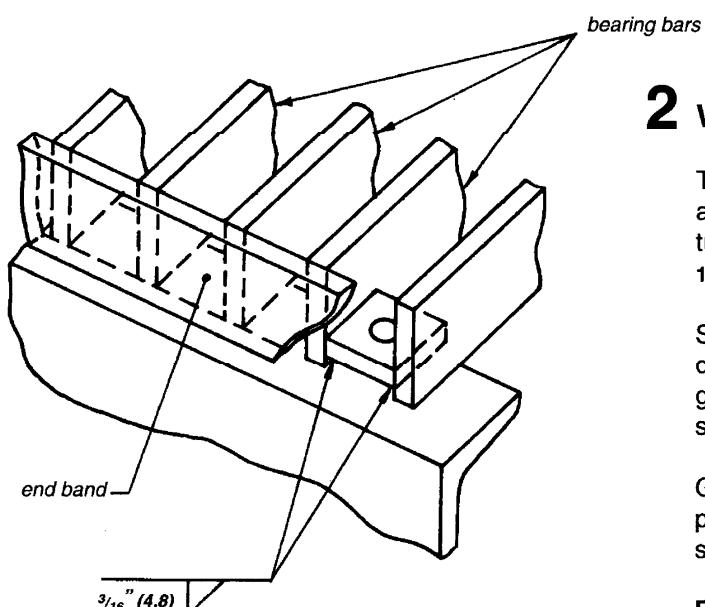

## 2 WELD LUGS

The designer shall specify when weld lugs are to be provided by the grating manufacturer. When provided, weld lugs shall be  $1/4$  in. (6.4 mm) minimum thickness.

Size and pattern of bolts or studs shall be determined by application and/or size of grating. Minimum pattern shall be as shown in welded anchorage (above).

Grating panels shall be used as a template by installing activity to locate holes or studs on structural supports.

**Bolts, studs and miscellaneous hardware are not supplied by the grating manufacturer.**


## FOR GRATING INSTALLATION

cross bars on top.

ed at supports only when the system has been designed for such modification and is specified by the design engineer and/or indicated on the plans.

Metal shall be used for all grating supports.

- ★ 1 in. (25.4 mm) minimum bearing surface shall be provided for bearing bar depths up to 2 1/4 in. (57.2 mm), and 2 in. (50.8 mm) minimum bearing surface shall be provided for depths of 2 1/2 in. (63.5 mm) and over at each end of span.

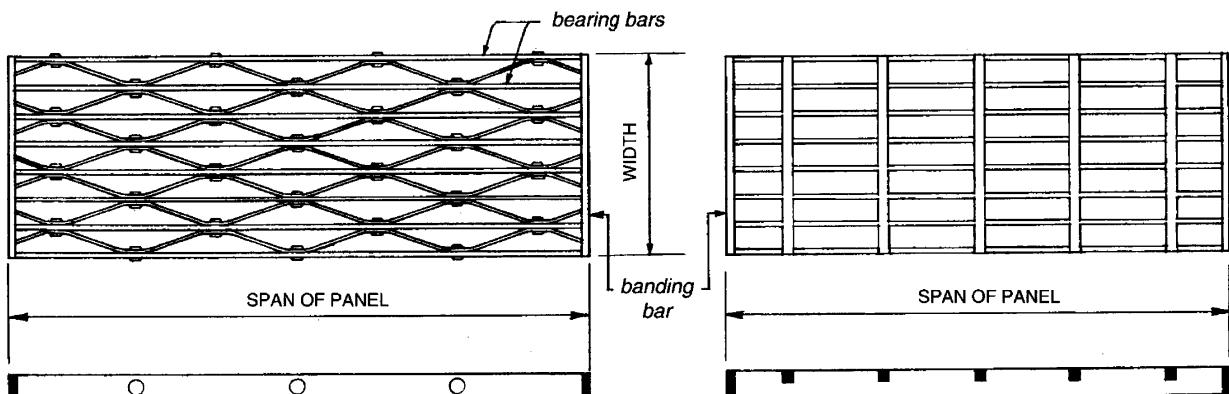


SPAN of panel is measured parallel to the bearing bars.

WIDTH of panel is measured perpendicular to the bearing bars, even if this dimension exceeds the panel span.

### SUPPORT and BANDING of TRENCH GRATING

Each end of a metal bar grating panel installed in a trench shall be supported on an angle or other shape whose inside vertical dimension equals that of the bearing bar.

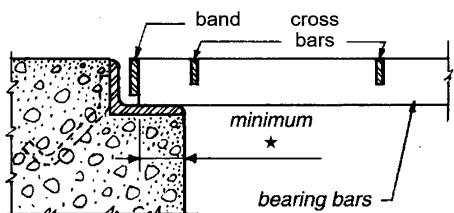


Specify banding on all gratings subject to rolling loads. Full depth band is supplied by manufacturer for all banded grating unless owner or specifier states clearly that shallow banding shall be provided.

For trench grating, banding bar shall be 1/4 in. (6.4 mm) to 1/2 in. (12.7 mm) less than depth of grating to permit drainage.



HEAVY DUTY WELDED GRATING

**STANDARD  
INSTALLATION CLEARANCES**

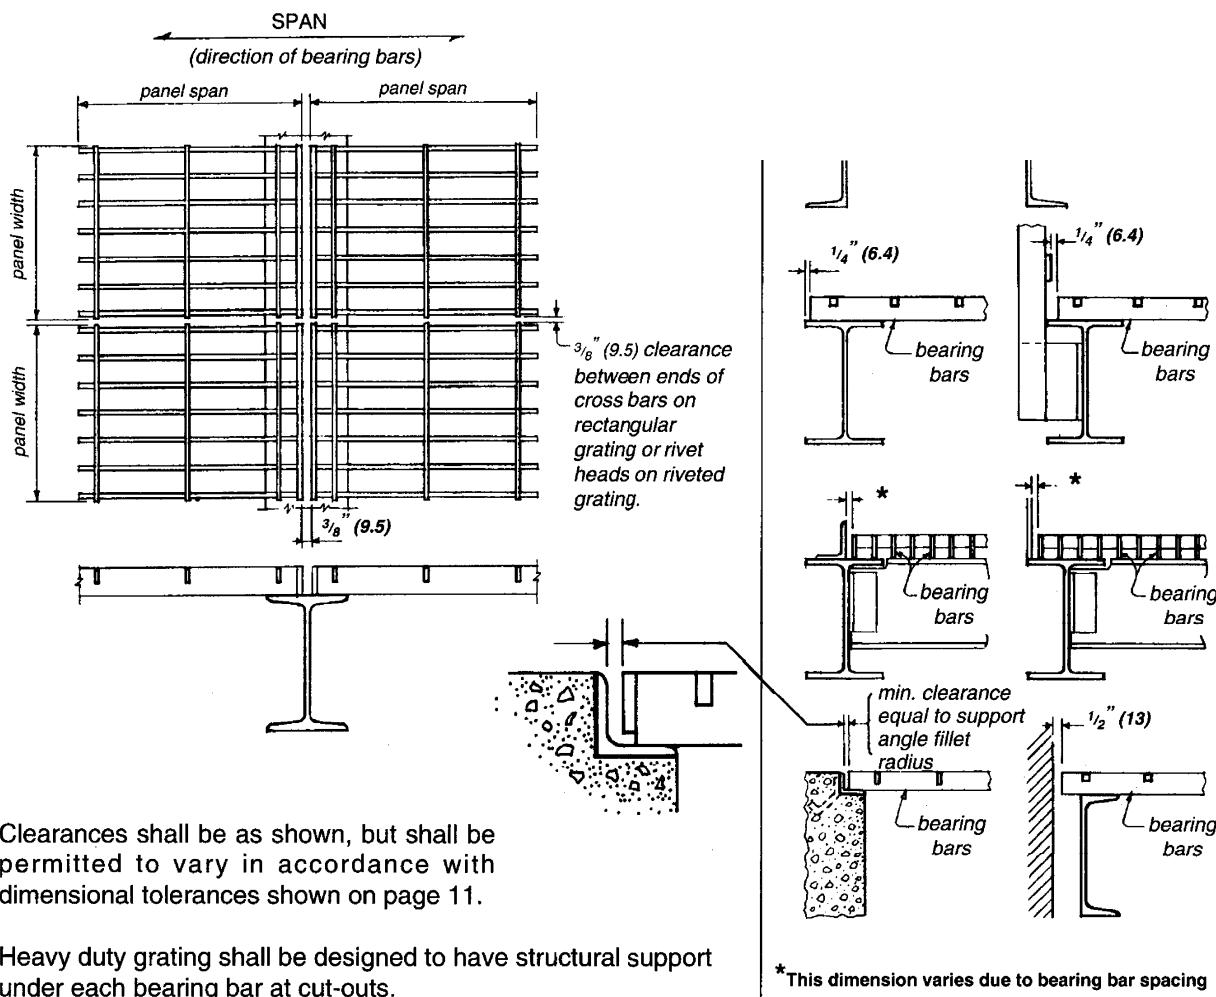

Clearances shall be as shown, but shall be permitted to vary in accordance with dimensional tolerances shown on page 11.


Heavy duty grating shall be designed to have structural support under each bearing bar at cut-outs.








**HEAVY DUTY RIVETED GRATING**

All dimensions given are maximum permissible tolerances

## MANUFACTURING TOLERANCES

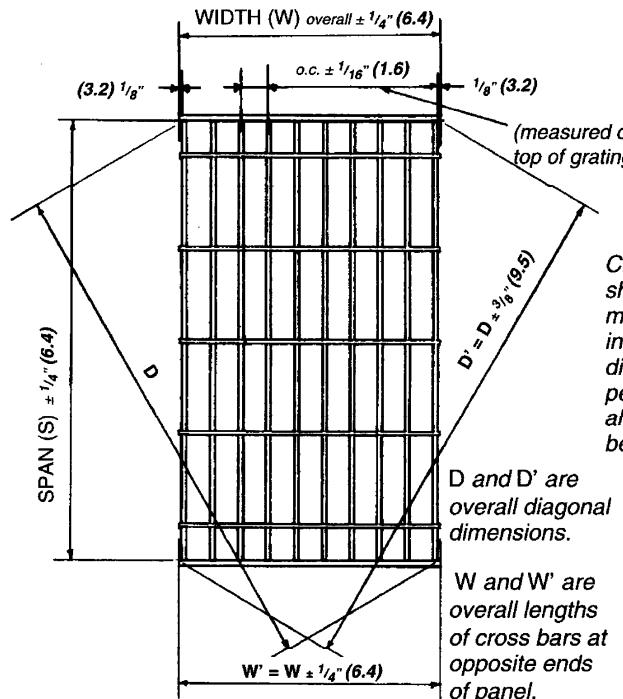


overall dimensions and squareness

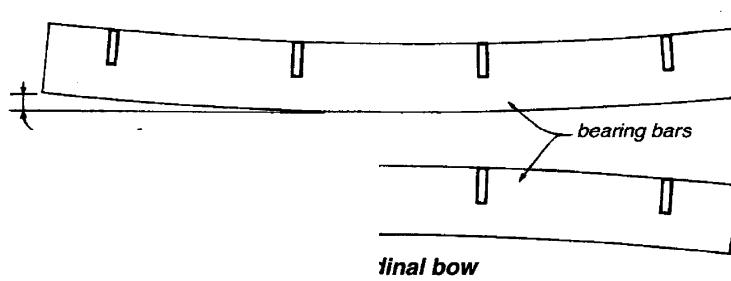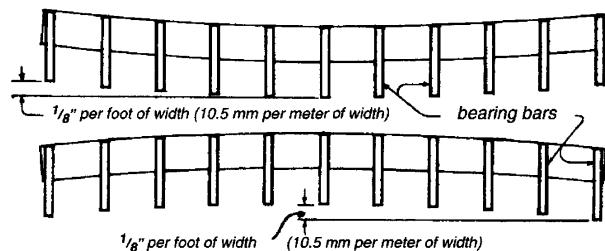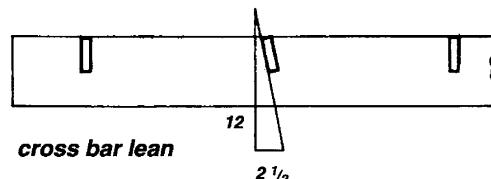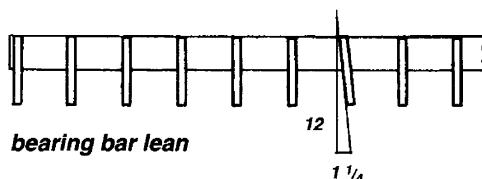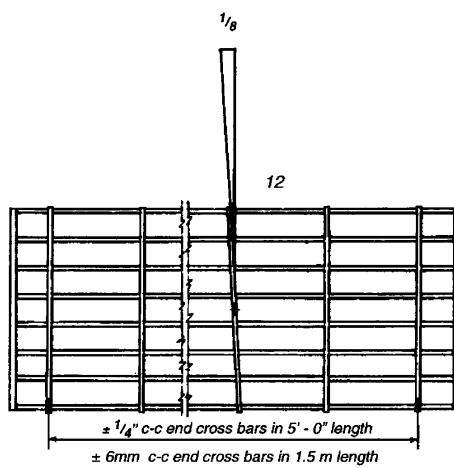


## WELDING OF TOE PLATES AND BANDING

### TOE PLATES

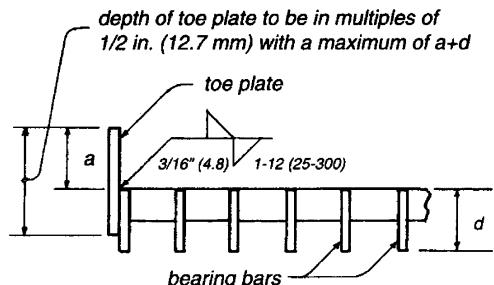

$a$  = toe plate projection

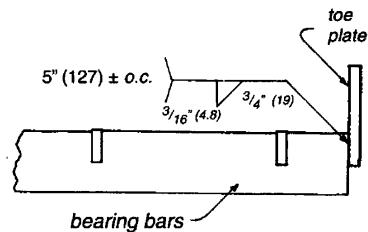


$d$  = bearing bar depth


### BANDING

Minimum thickness =  $1/4$  in. (6.4 mm)

For standard banding, band bar shall be same depth as bearing bars.


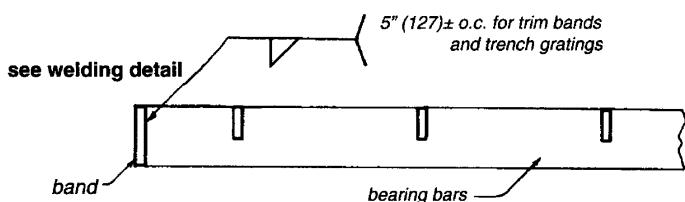


### STANDARD TRIM BAND

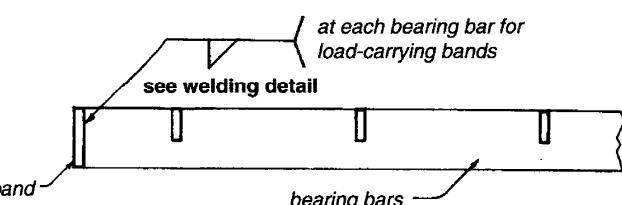

### LOAD BANDING (shall be specified)

For trench grating, banding bar shall be  $1/4$  in. (6.4 mm) to  $1/2$  in. (12.7 mm) less than depth of grating to permit drainage. Full depth band shall be supplied by manufacturer for all banded grating unless owner of specificier states clearly that shallow banding shall be provided.

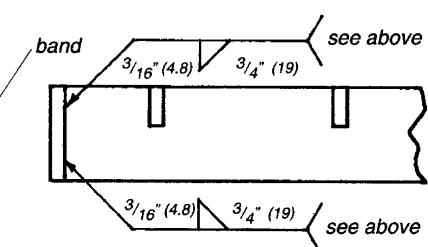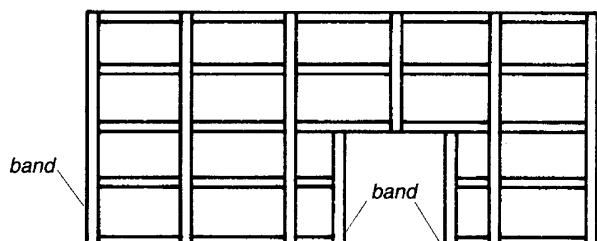

### WELDING DETAIL

For depth less than  $2-1/2$  in. (63.5 mm), weld one side at top.

For depth  $2-1/2$  in. (63.5 mm) or greater, weld one side at top, opposite side at bottom; or weld exceeding one-half depth on one side only.

Banding heavy duty metal bar gratings at panel ends and cut-outs improves durability while enhancing appearance. By increasing transverse stiffness, banding point of contact. Where light vehicular traffic flow is part sufficient. For heavy, high speed or multi-directional traffic the effects of impact and fatigue. Structural support sh vehicular traffic.

**when specifying or purchasing METAL BAR GRATING:**

---

**Description of grating** (see standard marking system, page 4 of this Manual)

**A drawing, showing:** area to be covered (including all cutouts)  
span (direction of bearing bars)  
method of support (including locations of weld lugs if specified)  
all critical dimensions  
(indicate whether clearances are taken into account)  
serrated or plain surface

**Type of anchorage :** (see page 8 of this Manual)

**Finish:** Steel gratings—manufacturer's standard paint or galvanized

**Shipping instructions**

## **REFERENCES**

*These references on this page are not a part of this standard since they were not approved by a consensus group, and some authorities do not recognize any document containing references which have not had consensus approval. However, NAAMM feels that the information contained in these references is of benefit to the users of this Heavy Duty Metal Bar Grating Manual.*

### **NAAMM STANDARD MBG 533 - Welding Specifications for Fabrication of Steel, Aluminum and Stainless Steel Bar Grating**

This Standard covers fillet welding requirements as they apply to bar grating but not high stress structural welds. Welder qualification forms are included.

### **NAAMM STANDARD MBG 534 - Metal Bar Grating Engineering Design Manual**

This Standard was developed to provide a clearer understanding of the procedures used in the design of grating and in the development of load tables.

## SPECIFICATIONS

# STANDARD SP

## for Heavy Duty Metal Bar Grating

### I. SCOPE

These specifications apply to heavy duty metal bar grating as hereinafter defined and described.

### II. DEFINITIONS

- a) Heavy duty metal bar grating is an open grid of metal bars. The bearing bars, which have a cross-sectional depth not less than two times their width, are held at regular parallel spacing, either by:
  - 1. Straight, sinuous or corrugated cross bars having their longitudinal axes perpendicular to the bearing bar and being connected to them by welding, forging or mechanical locking, or by
  - 2. Reticuline bars alternately contacting adjacent bearing bars and riveted to them at regular intervals.
- b) Definitions of other terms shall conform to those given in the Glossary of Terms in the Heavy Duty Bar Grating Manual.

### III. MATERIALS

#### a) Steel Gratings

Steel used in bearing bars, cross bars and reticuline bars of rectangular section shall conform to ASTM A 1011/A 1011M, Commercial Steel (CS Type 2) for hot rolled carbon steel sheet and strip and ASTM A 36/A 36M for structural steel bars.

Cross bars made of wire rod shall conform to ASTM A 510 (A 510M) for carbon steel wire rods and coarse round wire, except that permissible tolerance on diameter of coarse round wire shall be  $\pm 0.005$  in. ( $\pm 0.13$  mm). Combinations of these steels are not prohibited from being welded together.

Rivets shall be of a steel as prescribed in ASTM A 575, 1/4 in. (6.4 mm) minimum diameter, flat head type.

#### b) Stainless Steel Gratings

Stainless steel used in bearing bars, cross bars and reticuline bars shall be Type 304, 304L, 316, or 316L alloy conforming to ASTM A 666.

Rivets shall be of a Type 300 series alloy as prescribed in ASTM A 493.

### IV. SIZE OF MEMBERS

- a) All bearing bars shall be of nominal size as shown in the Load Tables of the Heavy Duty Metal Bar Grating Manual.
- b) All materials shall be in accordance with the ASTM A6/A6M tolerances.
- c) Banding Bars shall have a minimum thickness of 1/4" (6.4 mm).

### V. FABRICATION

- a) All tolerances shall be within the limits shown on page 11 of the Heavy Duty Metal Bar Grating Manual.
- b) Banding and toe plates, when specified, shall be attached by welding as shown on page 12 of the Heavy Duty Metal Bar Grating Manual.
- c) Unless specifically ordered otherwise, no welds anywhere on the grating will be ground.
- d) Finishes: steel gratings, unless specified to be galvanized or unpainted, shall have all surfaces painted with one shop coat of manufacturer's standard paint, applied in accordance with the manufacturer's standard practice. One shop coat of manufacturer's standard paint is designed to protect the grating from the elements during transit. Grating stored at the jobsite shall be covered or under a roof. Required covering is not the responsibility of the grating supplier. Gratings specified to be galvanized shall have their exposed surfaces zinc-coated by the hot dip process after fabrication, with a coating of not less than 1.8 oz/ft<sup>2</sup> (550 g/m<sup>2</sup>) of coated surface.

### VI. ANCHORAGE

Unless otherwise specified, gratings shall be welded to their supports as specified in accordance with page 8 of the Heavy Duty Metal Bar Grating Manual.

If weld lugs are required they shall be so specified and shall be welded to the grating by the manufacturer where specified in accordance with the provisions for weld lugs on page 8 of the Heavy Duty Metal Bar Grating Manual.

**CODE OF STANDARD PRACTICE**

**The following Code represents generally accepted standard practice in the metal bar grating industry. In order to avoid misunderstanding, these practices apply only to manufacturers individually adopting them, and then, only to the extent each manufacturer has not made unilateral modifications. Each manufacturer is free to modify the Code generally or as it specifically agrees with any Buyer.**

---

## **1. GENERAL**

### **1.1 Scope and Application**

The rules and practices contained in this Code were developed by the NAAMM Metal Bar Grating Division as a standard for the industry. Unless specifically stated otherwise, they shall be considered applicable to, and a part of, all contracts relating to the purchase and supply of metal bar gratings.

No provisions herein contained, however, shall be construed as denying the right of any company to fix its own prices and terms of sale, or restricting any Buyer or Seller from voiding, by mutual agreement, any part of this Code.

### **1.2 Definitions**

As used in this Code, the term "product" or "products" refers to metal bar gratings and their accessories; the term "Buyer" to the party, or authorized representative of the party, who contracts to purchase such products, and the term "Seller" to the manufacturer who contracts to supply them.

### **1.3 Designs and Materials**

Unless otherwise specified, all designs and materials shall be in accordance with the Standard Specifications for Heavy Duty Metal Bar Gratings as published in the current edition of the NAAMM Heavy Duty Metal Bar Grating Manual.

## **2. QUOTATIONS**

### **2.1 Bidding Plans**

Plans intended to serve as the basis for bidding shall provide complete information as to the description of the product, the limits of areas to be covered, the direction of span of grating panels, all supporting members, all cutouts to be provided in the grating area, anchors if required, and finishes desired. Note: For heavy duty applications all cutouts shall be structurally supported.

### **2.2 Basis of Unit Price Quotations**

Quotations shall preferably be on the basis of unit price per square foot (square meter) of grating. The quoted grating price shall be for grating furnished in rectangular sections as defined in Section 4 - Quantity Measurements.

## **CODE OF PRACTICE**

### **2.3 Extras**

The following are examples of items not included in quotations:

Anchors	Special banding or strapping other than steel strapping
Banding	Special drilling, punching or tapping
Cutting	Support plates or angles
Degreasing or sandblasting	Toe plates
Field measurement	Any materials, practices or finishes not called for in the Standard Specifications for Heavy Duty
Forming, undercutting or notching	Metal Bar Gratings, including special welding
Hinges	if galvanized in accord with ASTM A 385
Installation	
Locking Devices	
Physical testing	

Research of structural steel detail drawings to determine the cutout dimensions for vertical bracing and moment connections when such details are not furnished prior to start of preparation of grating drawings

## **3. DRAWINGS AND SPECIFICATIONS**

### **3.1 Construction Drawings and Specifications**

The buyer shall be expected to furnish to the seller a set of construction drawings and specifications of current issue showing the layout of supports and floor openings correctly dimensioned, together with the sizes and types of grating desired. Should cutouts for vertical bracing or moment connections be required for shop fabrication, the structural steel detail drawings shall be furnished prior to the preparation of the grating drawings.

If construction drawings and specifications are not available the buyer shall provide complete information regarding all items listed in "Information to be Provided" as shown on page 13 of the NAAMM Heavy Duty Metal Bar Grating Manual.

### **3.2 Limit of Seller's Responsibility**

In the absence of written notice to the contrary, the Buyer's construction plans and specifications shall be assumed by the Seller to be correct in all details, and the Seller's responsibility shall be limited to furnishing the products in accord with these documents.

### **3.3 Approval Drawings**

If requested by the Buyer, the Seller shall submit to the Buyer three (3) prints or one reproducible paper copy of detailed drawings in outline form for the latter's approval. The Buyer shall return one copy marked with his approval or desired changes. Changes in original construction plans and specifications may result in additional work by the Seller not contemplated by the contract. This additional work, unless expressly covered by contract, may result in additional negotiations between Buyer and Seller to reach agreement on the cost of the changes. After all necessary conditions and/or changes are made, the drawings shall be re-submitted to the Buyer for his final approval. The Seller shall not proceed with any shop work until drawings are finally approved.

### **3.4 Installation Drawings**

If requested, the Seller shall furnish to the Buyer a maximum of four sets of prints or one reproducible paper copy of all installation drawings.


## **4. QUANTITY MEASUREMENTS**

- 4.1      Quantity measurements for gratings ordered to specific dimensions, without drawings, shall be based on width times span of each panel, with no deduction made for cutouts, unless allowances for cutouts have been negotiated.

Drawings shall be on the basis of gross area measured supporting angles or channels, or overall dimensions of for clearances. Allowances for cutouts shall be deter-

ll be allowed only when the diameter of the cutout exceeds 3'-6" (1067 mm). The deduction allowance shall be equal to one-half the square of the diameter of the cutout.

- b) Deductions in the area for cutouts other than circular shall be allowed only when the cutout area exceeds nine (9) square feet (0.836 square meter).
- c) No deductions shall be allowed for any triangular segment or corners of gratings wasted in skew cuts.
- d) For special applications, such as (but not limited to) containment areas in nuclear power plants, the final grating quantities shall be the total gross area of all the pieces furnished with no allowance for cutouts. See the following sketches.

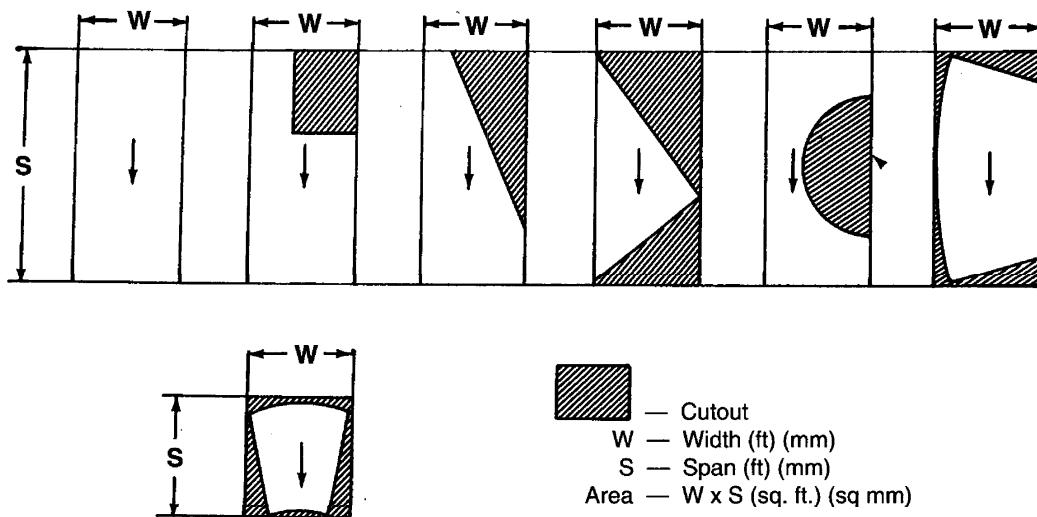

- 4.3** Measurement of cuts shall be on the basis of a minimum of one (1) lineal foot (300 mm) per cut per panel. Any cut in excess of one (1) lineal foot (300 mm) shall be measured to the next higher lineal foot (300 mm). (See diagram at the right).
- 4.4** Measurement of bandings, toe plates and nosings shall be on the same basis as that of cuts, as defined in 4.3.

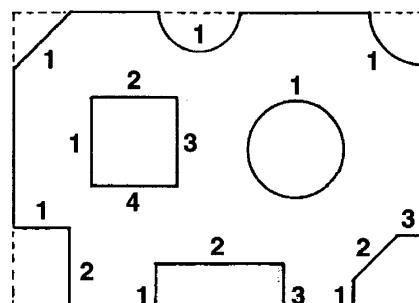


Diagram showing number of cuts required

## **CODE OF PRACTICE**

### **5. CHANGES IN SCOPE OF CONTACT**

- 5.1** If at any time during the course of the work the Bu  
and/or labor not called for in the original bidding p  
by the Buyer at a price to be agreed upon.

### **6. FIELD WORK**

- 6.1** The Seller shall not be responsible for taking actual measurements on construction work in the field.
- 6.2** Backcharges for field work of any kind are not acceptable without prior written authorization by the grat-  
ing supplier.

### **7. BACKCHARGES**

- 7.1** Upon discovery of unsatisfactory material, the Buyer shall immediately notify the Seller.
- 7.2** The Seller shall acknowledge receipt of the Buyer's complaint and initiate an investigation.
- 7.3** The Seller shall be given the opportunity to inspect the material PRIOR TO ANY CORRECTIVE WORK  
BEING DONE.
- 7.4** Seller is responsible for providing grating in accordance with approved drawings and specifications.  
Seller is not responsible for field changes, drawing changes not received and approved by Seller prior  
to grating fabrication, improper fabrication and/or erection of supporting members.
- 7.5** If the investigation and inspection confirm errors in Seller fabrication, the Seller agrees to repair and/or  
replace defective material at no charge to the Buyer.

**SECTION TABLES  
OR  
WELDED AND RIVETED  
HEAVY DUTY CARBON STEEL GRATINGS**

The load and deflection tables on the following pages have been prepared to provide the designer with a convenient reference for the load carrying capabilities of typical heavy duty grating constructions offered by NAAMM members. Uniform and concentrated loads per foot of grating width are given on six inch increments for spans ranging from one foot to eight feet. Metric tables provide loads per meter of grating width in 152.4 millimeters increments for spans from 304.8 millimeters to 2438.4 millimeters.

*The values in these load tables are based on allowable stresses for static loads and include the weight of the grating. The effects of impact and fatigue shall be considered when designing metal bar grating for vehicular traffic.*

The load tables for riveted grating are computed using the same method as the welded grating. This method of calculating the load carrying capacity of grating considers the strength of the bearing bars only. However, in most riveted designs the reticuline bars, which are riveted to the bearing bars, contribute to the longitudinal strength, thereby increasing the load carrying capacity of the grating, but to varying degrees. The varying contribution of these reticuline bars on the load carrying capacity is controlled by the following:

- a. Spacing of Bearing Bars
- b. Size of Reticuline Bars
- c. Spacing of Rivet Centers.

Contact any manufacturer of riveted metal bar grating for assistance in determining this contribution for a specific design and application.

Static load and deflection tables for	W-19-4	WELDED GRATING
	W-22-4	WELDED GRATING
	W-30-4	WELDED GRATING
	W-38-4	WELDED GRATING
	R-19-7	RIVETED GRATING
	R-37-5	RIVETED GRATING



LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot			C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches			
			Span in Inches						
42	48	54	60	66	72	78	84	90	96
458	351	277	225	186	156	133	115	100	88
0.253	0.330	0.418	0.517	0.626	0.743	0.873	1.015	1.163	1.325
802	702	624	561	510	468	432	401	374	351
0.202	0.264	0.335	0.413	0.499	0.595	0.698	0.809	0.928	1.057
688	527	416	337	279	234	199	172	150	132
0.254	0.331	0.419	0.517	0.627	0.745	0.872	1.014	1.165	1.328
1204	1053	936	843	766	702	648	602	562	527
0.203	0.265	0.335	0.414	0.501	0.596	0.699	0.811	0.931	1.060
716	548	433	351	290	244	208	179	156	137
0.203	0.265	0.335	0.414	0.501	0.597	0.701	0.811	0.932	1.059
1253	1097	975	877	798	731	675	627	585	548
0.162	0.212	0.268	0.331	0.401	0.477	0.560	0.650	0.745	0.847
1074	823	650	526	435	366	311	269	234	206
0.203	0.265	0.335	0.413	0.501	0.597	0.698	0.812	0.931	1.061
1880	1645	1462	1316	1196	1097	1012	940	877	823
0.162	0.212	0.268	0.331	0.400	0.477	0.559	0.649	0.744	0.848
1031	789	624	505	417	351	299	258	224	197
0.169	0.220	0.279	0.344	0.416	0.496	0.582	0.676	0.773	0.881
1804	1578	1403	1263	1148	1052	971	902	842	789
0.135	0.176	0.223	0.276	0.334	0.397	0.466	0.540	0.620	0.705
1547	1184	936	758	626	526	448	387	337	296
0.169	0.221	0.279	0.345	0.417	0.496	0.582	0.676	0.776	0.882
2707	2368	2105	1895	1722	1579	1457	1353	1263	1184
0.135	0.177	0.223	0.276	0.334	0.397	0.466	0.540	0.621	0.706
1403	1074	849	687	568	477	407	351	306	269
0.145	0.189	0.240	0.295	0.358	0.425	0.500	0.580	0.666	0.758
2455	2148	1910	1719	1562	1432	1322	1228	1146	1074
0.116	0.151	0.192	0.237	0.286	0.340	0.400	0.464	0.532	0.605
2105	1612	1273	1031	852	716	610	526	458	403
0.145	0.189	0.239	0.296	0.358	0.426	0.499	0.579	0.665	0.757
3684	3223	2865	2579	2344	2149	1984	1842	1719	1612
0.116	0.151	0.192	0.237	0.286	0.341	0.400	0.464	0.532	0.606
1833	1403	1109	898	742	624	531	458	399	351
0.127	0.166	0.210	0.259	0.313	0.373	0.437	0.507	0.582	0.662
3208	2807	2495	2245	2041	1871	1727	1604	1497	1403
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530
2749	2105	1663	1347	1113	936	797	687	599	526
0.127	0.166	0.210	0.259	0.313	0.373	0.437	0.507	0.582	0.662
4811	4210	3742	3368	3062	2807	2591	2406	2245	2105
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530
2321	1777	1404	1137	940	790	673	580	505	444
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.451	0.517	0.588
4061	3553	3159	2843	2584	2369	2187	2030	1895	1777
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471
3480	2664	2105	1705	1409	1184	1009	870	758	666
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.451	0.517	0.588
6090	5328	4736	4263	3875	3552	3279	3045	2842	2664
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.



LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches		
Span in Inches										
42	48	54	60	66	72	78	84	90	96	
2865	2193	1733	1404	1160	975	831	716	624	548	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530	
5013	4387	3899	3509	3190	2924	2699	2507	2340	2193	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.325	0.373	0.424	
4296	3289	2599	2105	1740	1462	1246	1074	936	822	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.529	
7518	6578	5847	5263	4784	4386	4048	3759	3508	3289	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.324	0.372	0.424	
4124	3158	2495	2021	1670	1403	1196	1031	898	789	
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441	
7217	6315	5613	5052	4593	4210	3886	3609	3368	3158	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
6187	4737	3743	3031	2505	2105	1794	1547	1347	1184	
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441	
10827	9473	8421	7579	6890	6316	5830	5413	5052	4737	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
5614	4298	3396	2751	2273	1910	1628	1404	1223	1075	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.379	
9825	8597	7641	6877	6252	5731	5290	4912	4585	4298	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
8421	6448	5094	4126	3410	2866	2442	2105	1834	1612	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378	
14737	12895	11462	10316	9378	8597	7935	7369	6877	6448	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
7333	5614	4436	3593	2969	2495	2126	1833	1597	1404	
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.253	0.291	0.331	
12832	11228	9981	8983	8166	7486	6910	6416	5988	5614	
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265	
10999	8421	6653	5389	4454	3743	3189	2750	2395	2105	
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331	
19248	16842	14970	13473	12248	11228	10364	9624	8982	8421	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
9280	7105	5614	4547	3758	3158	2691	2320	2021	1776	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
16240	14210	12631	11368	10335	9473	8745	8120	7579	7105	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
13920	10658	8421	6821	5637	4737	4036	3480	3031	2664	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
24360	21315	18947	17052	15502	14210	13117	12180	11368	10658	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
11457	8772	6931	5614	4640	3899	3322	2864	2495	2193	
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265	
20050	17543	15594	14035	12759	11696	10796	10025	9356	8772	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	
17185	13158	10396	8421	6959	5848	4983	4296	3743	3289	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
30074	26315	23391	21052	19138	17543	16194	15037	14035	13158	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.



LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot			C—Concentrated Load, Pounds per Foot of Width Span in Inches				D—Deflection, Inches		
42	48	54	60	66	72	78	84	90	96
396	303	240	194	160	135	115	99	86	76
0.253	0.331	0.420	0.517	0.624	0.746	0.875	1.013	1.160	1.327
693	607	539	485	441	404	373	347	324	303
0.203	0.265	0.335	0.414	0.500	0.595	0.699	0.812	0.932	1.058
593	454	359	291	240	202	172	148	129	114
0.253	0.330	0.418	0.517	0.624	0.744	0.873	1.010	1.160	1.327
1038	908	807	727	661	606	559	519	484	454
0.202	0.264	0.334	0.413	0.500	0.595	0.698	0.810	0.929	1.057
618	473	374	303	250	210	179	155	135	118
0.203	0.265	0.335	0.414	0.500	0.595	0.698	0.813	0.934	1.056
1082	947	841	757	688	631	583	541	505	473
0.162	0.212	0.268	0.331	0.400	0.477	0.560	0.649	0.745	0.847
927	710	561	454	376	316	269	232	202	178
0.203	0.265	0.335	0.413	0.501	0.596	0.699	0.811	0.930	1.061
1623	1420	1262	1136	1033	947	874	811	757	710
0.162	0.212	0.268	0.331	0.400	0.476	0.559	0.648	0.744	0.847
890	682	539	436	361	303	258	223	194	170
0.169	0.221	0.279	0.344	0.417	0.496	0.582	0.677	0.776	0.880
1558	1363	1212	1091	992	909	839	779	727	682
0.135	0.176	0.223	0.276	0.334	0.397	0.466	0.540	0.620	0.706
1336	1023	808	654	541	454	387	334	291	256
0.169	0.221	0.279	0.345	0.418	0.496	0.583	0.676	0.777	0.884
2337	2045	1818	1636	1487	1363	1258	1169	1091	1023
0.135	0.177	0.224	0.276	0.334	0.397	0.466	0.541	0.621	0.707
1213	928	733	594	491	413	352	303	264	232
0.145	0.189	0.239	0.296	0.358	0.426	0.501	0.580	0.665	0.757
2122	1857	1650	1485	1350	1238	1143	1061	990	928
0.116	0.152	0.192	0.237	0.286	0.341	0.400	0.464	0.532	0.606
1818	1392	1100	891	736	619	527	454	396	348
0.145	0.189	0.239	0.296	0.357	0.426	0.499	0.579	0.665	0.756
3181	2783	2474	2227	2024	1856	1713	1590	1484	1392
0.116	0.151	0.191	0.236	0.286	0.340	0.399	0.463	0.532	0.605
1584	1213	958	776	641	539	459	396	345	303
0.127	0.166	0.210	0.259	0.313	0.373	0.437	0.507	0.582	0.662
2771	2425	2156	1940	1764	1617	1492	1386	1293	1213
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530
2375	1818	1437	1164	962	808	689	594	517	455
0.127	0.166	0.210	0.259	0.313	0.372	0.437	0.507	0.582	0.663
4156	3637	3233	2909	2645	2424	2238	2078	1940	1818
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530
2004	1534	1212	982	811	682	581	501	436	384
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.451	0.517	0.589
3507	3068	2727	2455	2232	2046	1888	1753	1636	1534
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.360	0.414	0.471
3005	2301	1818	1473	1217	1023	871	751	654	575
0.113	0.147	0.186	0.230	0.278	0.331	0.388	0.450	0.517	0.588
5259	4602	4090	3681	3347	3068	2832	2630	2454	2301
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**W-22-4 HEAVY DUTY WELDED STEEL GRATINGS**

No. Bars/Ft. of Width 8.727				Allowable Fiber Stress 20,000 psi					
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches		
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches					
				12	18	24	30	36	
2½ x ¼	2.273	2.841	19.7	U	30307	13470	7577	4849	3367
				Du	0.008	0.019	0.033	0.052	0.075
				C	15153	10102	7577	6061	5051
				Dc	0.007	0.015	0.027	0.041	0.060
2½ x ¾/8	3.409	4.261	28.9	U	45453	20201	11363	7273	5050
				Du	0.008	0.019	0.033	0.052	0.075
				C	22727	15151	11363	9091	7576
				Dc	0.007	0.015	0.027	0.041	0.060
3 x ¼	3.273	4.909	23.4	U	43640	19396	10910	6982	4849
				Du	0.007	0.016	0.028	0.043	0.062
				C	21820	14547	10910	8728	7273
				Dc	0.006	0.012	0.022	0.035	0.050
3 x ¾/8	4.909	7.363	34.5	U	65453	29090	16363	10473	7273
				Du	0.007	0.016	0.028	0.043	0.062
				C	32727	21818	16363	13091	10909
				Dc	0.006	0.012	0.022	0.035	0.050
3½ x ¼	4.454	7.795	27.1	U	59387	26394	14847	9502	6599
				Du	0.006	0.013	0.024	0.037	0.053
				C	29693	19796	14847	11877	9898
				Dc	0.005	0.011	0.019	0.030	0.043
3½ x ¾/8	6.682	11.693	40.1	U	89093	39597	22273	14255	9899
				Du	0.006	0.013	0.024	0.037	0.053
				C	44547	29698	22273	17819	14849
				Dc	0.005	0.011	0.019	0.030	0.043
4 x ¼	5.818	11.636	30.8	U	77573	34477	19393	12412	8619
				Du	0.005	0.012	0.021	0.032	0.047
				C	38787	25858	19393	15515	12929
				Dc	0.004	0.009	0.017	0.026	0.037
4 x ¾/8	8.727	17.454	45.6	U	116360	51716	29090	18618	12929
				Du	0.005	0.012	0.021	0.032	0.047
				C	58180	38787	29090	23272	19393
				Dc	0.004	0.009	0.017	0.026	0.037
4½ x ¼	7.363	16.568	34.5	U	98173	43633	24543	15708	10908
				Du	0.005	0.010	0.018	0.029	0.041
				C	49087	32724	24543	19635	16362
				Dc	0.004	0.008	0.015	0.023	0.033
4½ x ¾/8	11.045	24.851	51.2	U	147267	65452	36817	23563	16363
				Du	0.005	0.010	0.018	0.029	0.041
				C	73633	49089	36817	29453	24544
				Dc	0.004	0.008	0.015	0.023	0.033
5 x ¼	9.091	22.727	38.2	U	121213	53873	30303	19394	13468
				Du	0.004	0.009	0.017	0.026	0.037
				C	60607	40404	30303	24243	20202
				Dc	0.003	0.007	0.013	0.021	0.030
5 x ¾/8	13.636	34.09	56.8	U	181813	80806	45453	29090	20201
				Du	0.004	0.009	0.017	0.026	0.037
				C	90907	60604	45453	36363	30302
				Dc	0.003	0.007	0.013	0.021	0.030

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches		
Span in Inches										
42	48	54	60	66	72	78	84	90	96	
2474	1894	1497	1212	1002	842	717	619	539	474	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530	
4330	3788	3367	3031	2755	2526	2331	2165	2020	1894	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.325	0.372	0.424	
3710	2841	2245	1818	1503	1263	1076	928	808	710	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530	
6493	5682	5050	4545	4132	3788	3496	3247	3030	2841	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.325	0.372	0.424	
3562	2728	2155	1746	1443	1212	1033	891	776	682	
0.085	0.110	0.140	0.173	0.209	0.248	0.291	0.338	0.388	0.442	
6234	5455	4849	4364	3967	3637	3357	3117	2909	2728	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
5343	4091	3232	2618	2164	1818	1549	1336	1164	1023	
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.442	
9350	8182	7273	6545	5950	5454	5035	4675	4364	4091	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
4848	3712	2933	2375	1963	1650	1406	1212	1056	928	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378	
8484	7423	6599	5939	5399	4949	4568	4242	3959	3712	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
7273	5568	4400	3564	2945	2475	2109	1818	1584	1392	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378	
12728	11137	9899	8909	8099	7424	6853	6364	5940	5568	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
6333	4848	3831	3103	2564	2155	1836	1583	1379	1212	
0.063	0.083	0.105	0.129	0.156	0.186	0.219	0.253	0.291	0.331	
11082	9697	8619	7757	7052	6464	5967	5541	5172	4848	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
9499	7273	5746	4654	3847	3232	2754	2375	2069	1818	
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331	
16623	14545	12929	11636	10578	9697	8951	8311	7757	7273	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
8014	6136	4848	3927	3245	2727	2324	2004	1745	1534	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
14025	12272	10908	9817	8925	8181	7552	7012	6545	6136	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
12022	9204	7272	5891	4868	4091	3486	3005	2618	2301	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
21038	18408	16363	14727	13388	12272	11328	10519	9818	9204	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
9895	7576	5986	4849	4007	3367	2869	2474	2155	1894	
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265	
17316	15152	13468	12121	11019	10101	9324	8658	8081	7576	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	
14842	11363	8978	7273	6010	5050	4303	3710	3232	2841	
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265	
25973	22727	20201	18181	16528	15151	13986	12987	12121	11363	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**W-30-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width 6.400				Allowable Fiber Stress 20,000 psi				
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches	
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches				
				12	18	24	30	36
1 x 1/4	0.267	0.133	6.6	U 3560	1582	890	570	396
				Du 0.021	0.047	0.083	0.130	0.187
				C 1780	1187	890	712	593
				Dc 0.017	0.037	0.067	0.104	0.149
1 x 3/8	0.4	0.2	9.3	U 5333	2370	1333	853	593
				Du 0.021	0.047	0.083	0.129	0.186
				C 2667	1778	1333	1067	889
				Dc 0.017	0.037	0.066	0.104	0.149
1 1/4 x 1/4	0.417	0.26	7.9	U 5560	2471	1390	890	618
				Du 0.017	0.037	0.066	0.104	0.149
				C 2780	1853	1390	1112	927
				Dc 0.013	0.030	0.053	0.083	0.120
1 1/4 x 3/8	0.625	0.391	11.3	U 8333	3704	2083	1333	926
				Du 0.017	0.037	0.066	0.103	0.149
				C 4167	2778	2083	1667	1389
				Dc 0.013	0.030	0.053	0.083	0.119
1 1/2 x 1/4	0.6	0.45	9.3	U 8000	3556	2000	1280	889
				Du 0.014	0.031	0.055	0.086	0.124
				C 4000	2667	2000	1600	1333
				Dc 0.011	0.025	0.044	0.069	0.099
1 1/2 x 3/8	0.9	0.675	13.4	U 12000	5333	3000	1920	1333
				Du 0.014	0.031	0.055	0.086	0.124
				C 6000	4000	3000	2400	2000
				Dc 0.011	0.025	0.044	0.069	0.099
1 3/4 x 1/4	0.817	0.715	10.6	U 10893	4841	2723	1743	1210
				Du 0.012	0.027	0.047	0.074	0.106
				C 5447	3631	2723	2179	1816
				Dc 0.010	0.021	0.038	0.059	0.085
1 3/4 x 3/8	1.225	1.072	15.4	U 16333	7259	4083	2613	1815
				Du 0.012	0.027	0.047	0.074	0.106
				C 8167	5444	4083	3267	2722
				Dc 0.010	0.021	0.038	0.059	0.085
2 x 1/4	1.067	1.067	12.0	U 14227	6323	3557	2276	1581
				Du 0.010	0.023	0.041	0.065	0.093
				C 7113	4742	3557	2845	2371
				Dc 0.008	0.019	0.033	0.052	0.075
2 x 3/8	1.6	1.6	17.4	U 21333	9481	5333	3413	2370
				Du 0.010	0.023	0.041	0.065	0.093
				C 10667	7111	5333	4267	3556
				Dc 0.008	0.019	0.033	0.052	0.075
2 1/4 x 1/4	1.35	1.519	13.4	U 18000	8000	4500	2880	2000
				Du 0.009	0.021	0.037	0.058	0.083
				C 9000	6000	4500	3600	3000
				Dc 0.007	0.017	0.029	0.046	0.066
2 1/4 x 3/8	2.025	2.278	19.5	U 27000	12000	6750	4320	3000
				Du 0.009	0.021	0.037	0.058	0.083
				C 13500	9000	6750	5400	4500
				Dc 0.007	0.017	0.029	0.046	0.066

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot			C—Concentrated Load, Pounds per Foot of Width Span in Inches					D—Deflection, Inches		
42	48	54	60	66	72	78	84	90	96	
291	223	176	142	118	99	84	73	63	56	
0.255	0.333	0.421	0.518	0.630	0.749	0.875	1.023	1.163	1.338	
509	445	396	356	324	297	274	254	237	223	
0.204	0.266	0.337	0.415	0.503	0.599	0.702	0.813	0.933	1.066	
435	333	263	213	176	148	126	109	95	83	
0.253	0.331	0.418	0.516	0.625	0.744	0.873	1.015	1.166	1.319	
762	667	593	533	485	444	410	381	356	333	
0.203	0.265	0.335	0.414	0.501	0.595	0.699	0.811	0.932	1.058	
454	348	275	222	184	154	132	113	99	87	
0.203	0.266	0.337	0.414	0.502	0.596	0.703	0.810	0.935	1.063	
794	695	618	556	505	463	428	397	371	348	
0.163	0.212	0.269	0.332	0.401	0.478	0.561	0.650	0.747	0.851	
680	521	412	333	275	231	197	170	148	130	
0.203	0.265	0.335	0.413	0.499	0.594	0.698	0.810	0.929	1.057	
1190	1042	926	833	758	694	641	595	556	521	
0.162	0.212	0.268	0.331	0.400	0.476	0.559	0.648	0.745	0.847	
653	500	395	320	264	222	189	163	142	125	
0.169	0.221	0.279	0.345	0.417	0.496	0.582	0.675	0.775	0.883	
1143	1000	889	800	727	667	615	571	533	500	
0.135	0.177	0.224	0.276	0.334	0.397	0.466	0.540	0.620	0.706	
980	750	593	480	397	333	284	245	213	188	
0.169	0.221	0.280	0.345	0.418	0.496	0.583	0.676	0.775	0.885	
1714	1500	1333	1200	1091	1000	923	857	800	750	
0.135	0.177	0.223	0.276	0.334	0.397	0.466	0.541	0.621	0.706	
889	681	538	436	360	303	258	222	194	170	
0.145	0.189	0.239	0.296	0.358	0.426	0.500	0.578	0.666	0.756	
1556	1362	1210	1089	990	908	838	778	726	681	
0.116	0.151	0.191	0.236	0.286	0.341	0.400	0.463	0.532	0.605	
1333	1021	807	653	540	454	387	333	290	255	
0.145	0.189	0.240	0.295	0.358	0.426	0.500	0.579	0.664	0.756	
2333	2042	1815	1633	1485	1361	1256	1167	1089	1021	
0.116	0.151	0.192	0.236	0.286	0.340	0.399	0.464	0.532	0.605	
1161	889	703	569	470	395	337	290	253	222	
0.127	0.166	0.210	0.259	0.313	0.372	0.437	0.506	0.582	0.661	
2032	1778	1581	1423	1293	1186	1094	1016	948	889	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.405	0.465	0.530	
1741	1333	1053	853	705	593	505	435	379	333	
0.127	0.166	0.209	0.259	0.313	0.373	0.437	0.507	0.582	0.661	
3048	2667	2370	2133	1939	1778	1641	1524	1422	1333	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530	
1469	1125	889	720	595	500	426	367	320	281	
0.113	0.147	0.186	0.230	0.278	0.331	0.388	0.450	0.517	0.588	
2571	2250	2000	1800	1636	1500	1385	1286	1200	1125	
0.090	0.118	0.149	0.184	0.222	0.265	0.311	0.361	0.414	0.471	
2204	1688	1333	1080	893	750	639	551	480	422	
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.451	0.517	0.589	
3857	3375	3000	2700	2455	2250	2077	1929	1800	1688	
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**W-30-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width 6.400				Allowable Fiber Stress 20,000 psi				
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches	
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches				
				12	18	24	30	36
2 <sup>1</sup> / <sub>2</sub> x 1 <sup>1</sup> / <sub>4</sub>	1.667	2.083	14.7	U 22227	9879	5557	3556	2470
				Du 0.008	0.019	0.033	0.052	0.075
				C 11113	7409	5557	4445	3704
				Dc 0.007	0.015	0.027	0.041	0.060
2 <sup>1</sup> / <sub>2</sub> x 3 <sup>3</sup> / <sub>8</sub>	2.5	3.125	21.5	U 33333	14815	8333	5333	3704
				Du 0.008	0.019	0.033	0.052	0.075
				C 16667	11111	8333	6667	5556
				Dc 0.007	0.015	0.027	0.041	0.060
3 x 1 <sup>1</sup> / <sub>4</sub>	2.4	3.6	17.4	U 32000	14222	8000	5120	3556
				Du 0.007	0.016	0.028	0.043	0.062
				C 16000	10667	8000	6400	5333
				Dc 0.006	0.012	0.022	0.035	0.050
3 x 3 <sup>3</sup> / <sub>8</sub>	3.6	5.4	25.6	U 48000	21333	12000	7680	5333
				Du 0.007	0.016	0.028	0.043	0.062
				C 24000	16000	12000	9600	8000
				Dc 0.006	0.012	0.022	0.035	0.050
3 <sup>1</sup> / <sub>2</sub> x 1 <sup>1</sup> / <sub>4</sub>	3.267	5.717	20.2	U 43560	19360	10890	6970	4840
				Du 0.006	0.013	0.024	0.037	0.053
				C 21780	14520	10890	8712	7260
				Dc 0.005	0.011	0.019	0.030	0.043
3 <sup>1</sup> / <sub>2</sub> x 3 <sup>3</sup> / <sub>8</sub>	4.9	8.575	29.7	U 65333	29037	16333	10453	7259
				Du 0.006	0.013	0.024	0.037	0.053
				C 32667	21778	16333	13067	10889
				Dc 0.005	0.011	0.019	0.030	0.043
4 x 1 <sup>1</sup> / <sub>4</sub>	4.267	8.533	22.9	U 56893	25286	14223	9103	6321
				Du 0.005	0.012	0.021	0.032	0.047
				C 28447	18964	14223	11379	9482
				Dc 0.004	0.009	0.017	0.026	0.037
4 x 3 <sup>3</sup> / <sub>8</sub>	6.4	12.800	33.8	U 85333	37926	21333	13653	9481
				Du 0.005	0.012	0.021	0.032	0.047
				C 42667	28444	21333	17067	14222
				Dc 0.004	0.009	0.017	0.026	0.037
4 <sup>1</sup> / <sub>2</sub> x 1 <sup>1</sup> / <sub>4</sub>	5.4	12.15	25.6	U 72000	32000	18000	11520	8000
				Du 0.005	0.010	0.018	0.029	0.041
				C 36000	24000	18000	14400	12000
				Dc 0.004	0.008	0.015	0.023	0.033
4 <sup>1</sup> / <sub>2</sub> x 3 <sup>3</sup> / <sub>8</sub>	8.1	18.225	37.8	U 108000	48000	27000	17280	12000
				Du 0.005	0.010	0.018	0.029	0.041
				C 54000	36000	27000	21600	18000
				Dc 0.004	0.008	0.015	0.023	0.033
5 x 1 <sup>1</sup> / <sub>4</sub>	6.667	16.667	28.3	U 88893	39508	22223	14223	9877
				Du 0.004	0.009	0.017	0.026	0.037
				C 44447	29631	22223	17779	14816
				Dc 0.003	0.007	0.013	0.021	0.030
5 x 3 <sup>3</sup> / <sub>8</sub>	10	25	41.9	U 133333	59259	33333	21333	14815
				Du 0.004	0.009	0.017	0.026	0.037
				C 66667	44444	33333	26667	22222
				Dc 0.003	0.007	0.013	0.021	0.030

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches	
Span in Inches									
42	48	54	60	66	72	78	84	90	96
1814	1389	1098	889	735	617	526	454	395	347
0.101	0.132	0.168	0.207	0.251	0.298	0.350	0.406	0.466	0.529
3175	2778	2470	2223	2021	1852	1710	1588	1482	1389
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.325	0.373	0.424
2721	2083	1646	1333	1102	926	789	680	593	521
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.405	0.466	0.530
4762	4167	3704	3333	3030	2778	2564	2381	2222	2083
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.324	0.372	0.424
2612	2000	1580	1280	1058	889	757	653	569	500
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441
4571	4000	3556	3200	2909	2667	2462	2286	2133	2000
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353
3918	3000	2370	1920	1587	1333	1136	980	853	750
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441
6857	6000	5333	4800	4364	4000	3692	3429	3200	3000
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353
3556	2723	2151	1742	1440	1210	1031	889	774	681
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.332	0.379
6223	5445	4840	4356	3960	3630	3351	3111	2904	2723
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303
5333	4083	3226	2613	2160	1815	1546	1333	1161	1021
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.332	0.378
9333	8167	7259	6533	5939	5444	5026	4667	4356	4083
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303
4644	3556	2810	2276	1881	1580	1347	1161	1011	889
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331
8128	7112	6321	5689	5172	4741	4376	4064	3793	3556
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265
6966	5333	4214	3413	2821	2370	2020	1741	1517	1333
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.253	0.291	0.331
12190	10667	9481	8533	7758	7111	6564	6095	5689	5333
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265
5878	4500	3556	2880	2380	2000	1704	1469	1280	1125
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294
10286	9000	8000	7200	6545	6000	5538	5143	4800	4500
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235
8816	6750	5333	4320	3570	3000	2556	2204	1920	1688
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294
15429	13500	12000	10800	9818	9000	8308	7714	7200	6750
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235
7257	5556	4390	3556	2939	2469	2104	1814	1580	1389
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265
12699	11112	9877	8889	8081	7408	6838	6350	5926	5556
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212
10884	8333	6584	5333	4408	3704	3156	2721	2370	2083
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265
19048	16667	14815	13333	12121	11111	10256	9524	8889	8333
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**W-38-4 HEAVY DUTY WELDED STEEL GRATIN(**

No. Bars/Ft. of Width 5.053				Allowable Fiber Stress 20,000 psi				
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches	
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches				
				12	18	24	30	36
1 x 1/4	0.211	0.105	5.4	U	2813	1250	703	450
				Du	0.021	0.047	0.083	0.130
				C	1407	938	703	563
				Dc	0.017	0.037	0.067	0.104
1 x 3/8	0.316	0.158	7.6	U	4213	1873	1053	674
				Du	0.021	0.047	0.083	0.129
				C	2107	1404	1053	843
				Dc	0.017	0.037	0.066	0.104
1 1/4 x 1/4	0.329	0.206	6.5	U	4387	1950	1097	702
				Du	0.017	0.037	0.066	0.103
				C	2193	1462	1097	877
				Dc	0.013	0.030	0.053	0.083
1 1/4 x 3/8	0.493	0.308	9.2	U	6573	2921	1643	1052
				Du	0.017	0.037	0.066	0.104
				C	3287	2191	1643	1315
				Dc	0.013	0.030	0.053	0.083
1 1/2 x 1/4	0.474	0.355	7.6	U	6320	2809	1580	1011
				Du	0.014	0.031	0.055	0.086
				C	3160	2107	1580	1264
				Dc	0.011	0.025	0.044	0.069
1 1/2 x 3/8	0.711	0.533	10.8	U	9480	4213	2370	1517
				Du	0.014	0.031	0.055	0.086
				C	4740	3160	2370	1896
				Dc	0.011	0.025	0.044	0.069
1 3/4 x 1/4	0.645	0.564	8.6	U	8600	3822	2150	1376
				Du	0.012	0.027	0.047	0.074
				C	4300	2867	2150	1720
				Dc	0.010	0.021	0.038	0.059
1 3/4 x 3/8	0.967	0.846	12.4	U	12893	5730	3223	2063
				Du	0.012	0.027	0.047	0.074
				C	6447	4298	3223	2579
				Dc	0.010	0.021	0.038	0.059
2 x 1/4	0.842	0.842	9.7	U	11227	4990	2807	1796
				Du	0.010	0.023	0.041	0.065
				C	5613	3742	2807	2245
				Dc	0.008	0.019	0.033	0.052
2 x 3/8	1.263	1.263	14.0	U	16840	7484	4210	2694
				Du	0.010	0.023	0.041	0.065
				C	8420	5613	4210	3368
				Dc	0.008	0.019	0.033	0.052
2 1/4 x 1/4	1.066	1.199	10.8	U	14213	6317	3553	2274
				Du	0.009	0.021	0.037	0.058
				C	7107	4738	3553	2843
				Dc	0.007	0.017	0.029	0.046
2 1/4 x 3/8	1.599	1.799	15.6	U	21320	9476	5330	3411
				Du	0.009	0.021	0.037	0.058
				C	10660	7107	5330	4264
				Dc	0.007	0.017	0.029	0.046

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot			C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches			
Span in Inches									
42	48	54	60	66	72	78	84	90	96
230	176	139	113	93	78	67	57	50	44
0.255	0.333	0.421	0.522	0.629	0.747	0.884	1.011	1.169	1.332
402	352	313	281	256	234	216	201	188	176
0.204	0.266	0.337	0.415	0.504	0.598	0.701	0.815	0.938	1.065
344	263	208	169	139	117	100	86	75	66
0.254	0.331	0.419	0.519	0.625	0.745	0.877	1.014	1.165	1.328
602	527	468	421	383	351	324	301	281	263
0.203	0.265	0.335	0.414	0.501	0.596	0.699	0.811	0.931	1.058
358	274	217	175	145	122	104	90	78	69
0.202	0.264	0.335	0.412	0.500	0.596	0.699	0.814	0.930	1.065
627	548	487	439	399	366	337	313	292	274
0.162	0.211	0.267	0.331	0.400	0.476	0.558	0.647	0.742	0.845
537	411	325	263	217	183	156	134	117	103
0.203	0.265	0.336	0.414	0.500	0.597	0.702	0.811	0.933	1.063
939	822	730	657	598	548	506	470	438	411
0.162	0.212	0.268	0.331	0.401	0.477	0.560	0.650	0.745	0.848
516	395	312	253	209	176	150	129	112	99
0.169	0.221	0.280	0.346	0.418	0.499	0.585	0.677	0.775	0.886
903	790	702	632	575	527	486	451	421	395
0.135	0.177	0.224	0.276	0.335	0.398	0.467	0.541	0.621	0.707
774	593	468	379	313	263	224	193	169	148
0.169	0.221	0.279	0.345	0.417	0.496	0.582	0.675	0.778	0.882
1354	1185	1053	948	862	790	729	677	632	593
0.135	0.177	0.224	0.276	0.334	0.397	0.466	0.541	0.621	0.707
702	538	425	344	284	239	204	176	153	134
0.145	0.190	0.240	0.296	0.358	0.426	0.501	0.581	0.666	0.755
1229	1075	956	860	782	717	662	614	573	538
0.116	0.151	0.192	0.237	0.286	0.341	0.400	0.464	0.532	0.606
1053	806	637	516	426	358	305	263	229	201
0.145	0.189	0.240	0.296	0.358	0.426	0.499	0.579	0.665	0.755
1842	1612	1433	1289	1172	1074	992	921	860	806
0.116	0.151	0.192	0.236	0.286	0.340	0.400	0.464	0.532	0.606
916	702	554	449	371	312	266	229	200	175
0.127	0.166	0.209	0.259	0.313	0.373	0.438	0.507	0.583	0.661
1604	1403	1247	1123	1021	936	864	802	748	702
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530
1375	1053	832	674	557	468	399	344	299	263
0.127	0.166	0.210	0.259	0.313	0.373	0.438	0.507	0.581	0.662
2406	2105	1871	1684	1531	1403	1295	1203	1123	1053
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530
1160	888	702	569	470	395	336	290	253	222
0.113	0.147	0.186	0.230	0.278	0.331	0.388	0.451	0.518	0.588
2030	1777	1579	1421	1292	1184	1093	1015	948	888
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471
1740	1333	1053	853	705	592	505	435	379	333
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.450	0.517	0.588
3046	2665	2369	2132	1938	1777	1640	1523	1421	1333
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**W-38-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width 5.053				Allowable Fiber Stress 20,000 psi					
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches		
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches					
				12	18	24	30	36	
2½ x ¼	1.316	1.645	11.9	U	17547	7799	4387	2807	1950
				Du	0.008	0.019	0.033	0.052	0.075
				C	8773	5849	4387	3509	2924
				Dc	0.007	0.015	0.027	0.041	0.060
2½ x ¾/8	1.974	2.467	17.2	U	26320	11698	6580	4211	2924
				Du	0.008	0.019	0.033	0.052	0.075
				C	13160	8773	6580	5264	4387
				Dc	0.007	0.015	0.027	0.041	0.060
3 x ¼	1.895	2.842	14.0	U	25267	11230	6317	4043	2807
				Du	0.007	0.016	0.028	0.043	0.062
				C	12633	8422	6317	5053	4211
				Dc	0.006	0.012	0.022	0.035	0.050
3 x ¾/8	2.842	4.263	20.5	U	37893	16841	9473	6063	4210
				Du	0.007	0.016	0.028	0.043	0.062
				C	18947	12631	9473	7579	6316
				Dc	0.006	0.012	0.022	0.035	0.050
3½ x ¼	2.579	4.513	16.2	U	34387	15283	8597	5502	3821
				Du	0.006	0.013	0.024	0.037	0.053
				C	17193	11462	8597	6877	5731
				Dc	0.005	0.011	0.019	0.030	0.043
3½ x ¾/8	3.869	6.77	23.7	U	51587	22927	12897	8254	5732
				Du	0.006	0.013	0.024	0.037	0.053
				C	25793	17196	12897	10317	8598
				Dc	0.005	0.011	0.019	0.030	0.043
4 x ¼	3.369	6.737	18.3	U	44920	19964	11230	7187	4991
				Du	0.005	0.012	0.021	0.032	0.047
				C	22460	14973	11230	8984	7487
				Dc	0.004	0.009	0.017	0.026	0.037
4 x ¾/8	5.053	10.106	26.9	U	67373	29944	16843	10780	7486
				Du	0.005	0.012	0.021	0.032	0.047
				C	33687	22458	16843	13475	11229
				Dc	0.004	0.009	0.017	0.026	0.037
4½ x ¼	4.263	9.593	20.5	U	56840	25262	14210	9094	6316
				Du	0.005	0.010	0.018	0.029	0.041
				C	28420	18947	14210	11368	9473
				Dc	0.004	0.008	0.015	0.023	0.033
4½ x ¾/8	6.395	14.389	30.1	U	85267	37896	21317	13643	9474
				Du	0.005	0.010	0.018	0.029	0.041
				C	42633	28422	21317	17053	14211
				Dc	0.004	0.008	0.015	0.023	0.033
5 x ¼	5.264	13.159	22.6	U	70187	31194	17547	11230	7799
				Du	0.004	0.009	0.017	0.026	0.037
				C	35093	23396	17547	14037	11698
				Dc	0.003	0.007	0.013	0.021	0.030
5 x ¾/8	7.895	19.738	33.3	U	105267	46785	26317	16843	11696
				Du	0.004	0.009	0.017	0.026	0.037
				C	52633	35089	26317	21053	17544
				Dc	0.003	0.007	0.013	0.021	0.030

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches	
Span in Inches									
42	48	54	60	66	72	78	84	90	96
1432	1097	867	702	580	487	415	358	312	274
0.101	0.133	0.168	0.207	0.250	0.298	0.349	0.405	0.466	0.529
2507	2193	1950	1755	1595	1462	1350	1253	1170	1097
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.324	0.373	0.424
2149	1645	1300	1053	870	731	623	537	468	411
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.529
3760	3290	2924	2632	2393	2193	2025	1880	1755	1645
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.325	0.373	0.424
2063	1579	1248	1011	835	702	598	516	449	395
0.085	0.110	0.140	0.173	0.209	0.248	0.291	0.338	0.388	0.442
3610	3158	2807	2527	2297	2106	1944	1805	1684	1579
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353
3093	2368	1871	1516	1253	1053	897	773	674	592
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441
5413	4737	4210	3789	3445	3158	2915	2707	2526	2368
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353
2807	2149	1698	1375	1137	955	814	702	611	537
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.332	0.378
4912	4298	3821	3439	3126	2866	2645	2456	2292	2149
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303
4211	3224	2547	2063	1705	1433	1221	1053	917	806
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378
7370	6448	5732	5159	4690	4299	3968	3685	3439	3224
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303
3667	2808	2218	1797	1485	1248	1063	917	799	702
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331
6417	5615	4991	4492	4084	3743	3455	3209	2995	2808
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265
5500	4211	3327	2695	2227	1871	1595	1375	1198	1053
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331
9625	8422	7486	6737	6125	5614	5183	4812	4492	4211
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265
4640	3553	2807	2274	1879	1579	1345	1160	1010	888
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294
8120	7105	6316	5684	5167	4737	4372	4060	3789	3553
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235
6961	5329	4211	3411	2819	2369	2018	1740	1516	1332
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294
12181	10658	9474	8527	7752	7106	6559	6090	5684	5329
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235
5730	4387	3466	2807	2320	1950	1661	1432	1248	1097
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265
10027	8773	7799	7019	6381	5849	5399	5013	4679	4387
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212
8593	6579	5198	4211	3480	2924	2492	2148	1871	1645
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265
15038	13158	11696	10527	9570	8772	8097	7519	7018	6579
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**R-19-7 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Ft. of Width (12/Ar+b)				"b"=1/4" "b"=3/8"	8.346 7.680	Allowable Rider Stress		20,000 psi	
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width		D—Deflection, Inches			
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches					
				12	18	24	30	36	
1 x 1/4	0.348	0.174	8.2	U	4640	2062	1160	742	516
				Du	0.021	0.047	0.083	0.129	0.186
				C	2320	1547	1160	928	773
				Dc	0.017	0.037	0.066	0.103	0.149
1 x 3/8	0.480	0.240	11.8	U	6400	2844	1600	1024	711
				Du	0.021	0.047	0.083	0.129	0.186
				C	3200	2133	1600	1280	1067
				Dc	0.017	0.037	0.066	0.103	0.149
1 1/4 x 1/4	0.543	0.34	10.0	U	7240	3218	1810	1158	804
				Du	0.017	0.037	0.066	0.103	0.149
				C	3620	2413	1810	1448	1207
				Dc	0.013	0.030	0.053	0.083	0.119
1 1/4 x 3/8	0.750	0.469	14.4	U	10000	4444	2500	1600	1111
				Du	0.017	0.037	0.066	0.103	0.149
				C	5000	3333	2500	2000	1667
				Dc	0.013	0.030	0.053	0.083	0.119
1 1/2 x 1/4	0.783	0.587	11.8	U	10440	4640	2610	1670	1160
				Du	0.014	0.031	0.055	0.086	0.124
				C	5220	3480	2610	2088	1740
				Dc	0.011	0.025	0.044	0.069	0.099
1 1/2 x 3/8	1.080	0.810	17.1	U	14400	6400	3600	2304	1600
				Du	0.014	0.031	0.055	0.086	0.124
				C	7200	4800	3600	2880	2400
				Dc	0.011	0.025	0.044	0.069	0.099
1 3/4 x 1/4	1.065	0.932	13.5	U	14200	6311	3550	2272	1578
				Du	0.012	0.027	0.047	0.074	0.106
				C	7100	4733	3550	2840	2367
				Dc	0.010	0.021	0.038	0.059	0.085
1 3/4 x 3/8	1.470	1.286	19.8	U	19600	8711	4900	3136	2178
				Du	0.012	0.027	0.047	0.074	0.106
				C	9800	6533	4900	3920	3267
				Dc	0.010	0.021	0.038	0.059	0.085
2 x 1/4	1.391	1.391	15.3	U	18547	8243	4637	2967	2061
				Du	0.010	0.023	0.041	0.065	0.093
				C	9273	6182	4637	3709	3091
				Dc	0.008	0.019	0.033	0.052	0.075
2 x 3/8	1.920	1.920	22.4	U	25600	11378	6400	4096	2844
				Du	0.010	0.023	0.041	0.065	0.093
				C	12800	8533	6400	5120	4267
				Dc	0.008	0.019	0.033	0.052	0.075
2 1/4 x 1/4	1.761	1.981	17.1	U	23480	10436	5870	3757	2609
				Du	0.009	0.021	0.037	0.058	0.083
				C	11740	7827	5870	4696	3913
				Dc	0.007	0.017	0.029	0.046	0.066
2 1/4 x 3/8	2.430	2.734	25.1	U	32400	14400	8100	5184	3600
				Du	0.009	0.021	0.037	0.058	0.083
				C	16200	10800	8100	6480	5400
				Dc	0.007	0.017	0.029	0.046	0.066

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot			C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches			
			Span in Inches						
42	48	54	60	66	72	78	84	90	96
379	290	229	186	153	129	110	95	82	73
0.254	0.331	0.419	0.518	0.624	0.746	0.876	1.017	1.157	1.333
663	580	516	464	422	387	357	331	309	290
0.203	0.265	0.336	0.414	0.501	0.596	0.700	0.810	0.930	1.059
522	400	316	256	212	178	151	131	114	100
0.253	0.331	0.419	0.517	0.627	0.746	0.871	1.017	1.166	1.324
914	800	711	640	582	533	492	457	427	400
0.203	0.265	0.335	0.414	0.501	0.596	0.699	0.811	0.932	1.059
591	452	358	290	239	201	171	148	129	113
0.202	0.264	0.335	0.414	0.499	0.594	0.697	0.811	0.931	1.056
1034	905	804	724	658	603	557	517	483	453
0.162	0.212	0.268	0.330	0.400	0.476	0.559	0.648	0.744	0.847
816	625	494	400	331	278	237	204	178	156
0.203	0.265	0.335	0.414	0.501	0.596	0.700	0.810	0.932	1.057
1429	1250	1111	1000	909	833	769	714	667	625
0.162	0.212	0.268	0.331	0.400	0.476	0.559	0.648	0.745	0.847
852	653	516	418	345	290	247	213	186	163
0.169	0.221	0.280	0.345	0.417	0.497	0.583	0.676	0.778	0.883
1491	1305	1160	1044	949	870	803	746	696	653
0.135	0.177	0.224	0.276	0.334	0.397	0.466	0.541	0.621	0.707
1176	900	711	576	476	400	341	294	256	225
0.169	0.221	0.279	0.345	0.417	0.497	0.583	0.676	0.776	0.883
2057	1800	1600	1440	1309	1200	1108	1029	960	900
0.135	0.177	0.223	0.276	0.334	0.397	0.466	0.541	0.621	0.706
1159	888	701	568	469	394	336	290	252	222
0.145	0.189	0.239	0.296	0.357	0.425	0.499	0.580	0.664	0.757
2029	1775	1578	1420	1291	1183	1092	1014	947	888
0.116	0.151	0.192	0.236	0.286	0.340	0.399	0.463	0.532	0.606
1600	1225	968	784	648	544	464	400	348	306
0.145	0.189	0.240	0.296	0.358	0.425	0.500	0.579	0.664	0.756
2800	2450	2178	1960	1782	1633	1508	1400	1307	1225
0.116	0.151	0.192	0.237	0.286	0.341	0.400	0.464	0.532	0.605
1514	1159	916	742	613	515	439	379	330	290
0.127	0.166	0.210	0.259	0.313	0.372	0.437	0.508	0.582	0.663
2650	2318	2061	1855	1686	1546	1427	1325	1236	1159
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530
2090	1600	1264	1024	846	711	606	522	455	400
0.127	0.166	0.210	0.259	0.313	0.372	0.437	0.507	0.582	0.662
3657	3200	2844	2560	2327	2133	1969	1829	1707	1600
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530
1917	1468	1160	939	776	652	556	479	417	367
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.450	0.517	0.589
3354	2935	2609	2348	2135	1957	1806	1677	1565	1468
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471
2645	2025	1600	1296	1071	900	767	661	576	506
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.450	0.517	0.588
4629	4050	3600	3240	2945	2700	2492	2314	2160	2025
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.360	0.414	0.471

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**R-19-7 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Ft. of Width (12/Ar+b)				"b"=1/4" "b"=3/8"	8.348 7.680	ALLOWABLE RIVET STRESS		20,000 psi	
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches		
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches					
				12	18	24	30	36	
$2\frac{1}{2} \times \frac{1}{4}$	2.174	2.717	18.9	U	28987	12883	7247	4638	3221
				Du	0.008	0.019	0.033	0.052	0.075
				C	14493	9662	7247	5797	4831
				Dc	0.007	0.015	0.027	0.041	0.060
$2\frac{1}{2} \times \frac{3}{8}$	3.000	3.750	27.7	U	40000	17778	10000	6400	4444
				Du	0.008	0.019	0.033	0.052	0.075
				C	20000	13333	10000	8000	6667
				Dc	0.007	0.015	0.027	0.041	0.060
$3 \times \frac{1}{4}$	3.131	4.696	22.4	U	41747	18554	10437	6679	4639
				Du	0.007	0.016	0.028	0.043	0.062
				C	20873	13916	10437	8349	6958
				Dc	0.006	0.012	0.022	0.035	0.050
$3 \times \frac{3}{8}$	4.320	6.480	33.1	U	57600	25600	14400	9216	6400
				Du	0.007	0.016	0.028	0.043	0.062
				C	28800	19200	14400	11520	9600
				Dc	0.006	0.012	0.022	0.035	0.050
$3\frac{1}{2} \times \frac{1}{4}$	4.261	7.457	26.0	U	56813	25250	14203	9090	6313
				Du	0.006	0.013	0.024	0.037	0.053
				C	28407	18938	14203	11363	9469
				Dc	0.005	0.011	0.019	0.030	0.043
$3\frac{1}{2} \times \frac{3}{8}$	5.880	10.290	38.4	U	78400	34844	19600	12544	8711
				Du	0.006	0.013	0.024	0.037	0.053
				C	39200	26133	19600	15680	13067
				Dc	0.005	0.011	0.019	0.030	0.043
$4 \times \frac{1}{4}$	5.565	11.131	29.5	U	74200	32978	18550	11872	8244
				Du	0.005	0.012	0.021	0.032	0.047
				C	37100	24733	18550	14840	12367
				Dc	0.004	0.009	0.017	0.026	0.037
$4 \times \frac{3}{8}$	7.680	15.360	43.7	U	102400	45511	25600	16384	11378
				Du	0.005	0.012	0.021	0.032	0.047
				C	51200	34133	25600	20480	17067
				Dc	0.004	0.009	0.017	0.026	0.037
$4\frac{1}{2} \times \frac{1}{4}$	7.044	15.848	33.1	U	93920	41742	23480	15027	10436
				Du	0.005	0.010	0.018	0.029	0.041
				C	46960	31307	23480	18784	15653
				Dc	0.004	0.008	0.015	0.023	0.033
$4\frac{1}{2} \times \frac{3}{8}$	9.720	21.870	49.0	U	129600	57600	32400	20736	14400
				Du	0.005	0.010	0.018	0.029	0.041
				C	64800	43200	32400	25920	21600
				Dc	0.004	0.008	0.015	0.023	0.033
$5 \times \frac{1}{4}$	8.696	21.74	36.6	U	115947	51532	28987	18551	12883
				Du	0.004	0.009	0.017	0.026	0.037
				C	57973	38649	28987	23189	19324
				Dc	0.003	0.007	0.013	0.021	0.030
$5 \times \frac{3}{8}$	12.000	30.000	54.3	U	160000	71111	40000	25600	17778
				Du	0.004	0.009	0.017	0.026	0.037
				C	80000	53333	40000	32000	26667
				Dc	0.003	0.007	0.013	0.021	0.030

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches		
Span in Inches										
42	48	54	60	66	72	78	84	90	96	
2366	1812	1431	1159	958	805	686	592	515	453	
0.101	0.133	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530	
4141	3623	3221	2899	2635	2416	2230	2070	1932	1812	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.324	0.372	0.424	
3265	2500	1975	1600	1322	1111	947	816	711	625	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.405	0.465	0.530	
5714	5000	4444	4000	3636	3333	3077	2857	2667	2500	
0.081	0.106	0.134	0.166	0.200	0.238	0.280	0.324	0.373	0.424	
3408	2609	2062	1670	1380	1160	988	852	742	652	
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441	
5964	5218	4639	4175	3795	3479	3211	2982	2783	2609	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
4702	3600	2844	2304	1904	1600	1363	1176	1024	900	
0.085	0.110	0.140	0.172	0.209	0.248	0.291	0.338	0.388	0.441	
8229	7200	6400	5760	5236	4800	4431	4114	3840	3600	
0.068	0.088	0.112	0.138	0.167	0.199	0.233	0.270	0.310	0.353	
4638	3551	2806	2273	1878	1578	1345	1159	1010	888	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378	
8116	7102	6313	5681	5165	4734	4370	4058	3788	3551	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
6400	4900	3872	3136	2592	2178	1856	1600	1394	1225	
0.072	0.095	0.120	0.148	0.179	0.213	0.250	0.290	0.333	0.378	
11200	9800	8711	7840	7127	6533	6031	5600	5227	4900	
0.058	0.076	0.096	0.118	0.143	0.170	0.200	0.232	0.266	0.303	
6057	4638	3664	2968	2453	2061	1756	1514	1319	1159	
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.253	0.291	0.331	
10600	9275	8244	7420	6745	6183	5708	5300	4947	4638	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
8359	6400	5057	4096	3385	2844	2424	2090	1820	1600	
0.063	0.083	0.105	0.129	0.157	0.186	0.219	0.254	0.291	0.331	
14629	12800	11378	10240	9309	8533	7877	7314	6827	6400	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
7667	5870	4638	3757	3105	2609	2223	1917	1670	1468	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
13417	11740	10436	9392	8538	7827	7225	6709	6261	5870	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
10580	8100	6400	5184	4284	3600	3067	2645	2304	2025	
0.056	0.074	0.093	0.115	0.139	0.166	0.194	0.225	0.259	0.294	
18514	16200	14400	12960	11782	10800	9969	9257	8640	8100	
0.045	0.059	0.075	0.092	0.111	0.132	0.155	0.180	0.207	0.235	
9465	7247	5726	4638	3833	3221	2744	2366	2061	1812	
0.051	0.066	0.084	0.104	0.125	0.149	0.175	0.203	0.233	0.265	
16564	14493	12883	11595	10541	9662	8919	8282	7730	7247	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	
13061	10000	7901	6400	5289	4444	3787	3265	2844	2500	
0.051	0.066	0.084	0.103	0.125	0.149	0.175	0.203	0.233	0.265	
22857	20000	17778	16000	14545	13333	12308	11429	10667	10000	
0.041	0.053	0.067	0.083	0.100	0.119	0.140	0.162	0.186	0.212	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**R-37-5 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Ft. of Width (12/Ar+b)				"b"=1/4" "b"=3/8"	4.663 4.465	Allowable Rider Stress		20,000 psi
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches	
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches				
				12	18	24	30	36
1 x 1/4	0.195	0.098	5.1	U	2600	1156	650	416
				Du	0.021	0.046	0.082	0.129
				C	1300	867	650	520
				Dc	0.017	0.037	0.066	0.103
1 x 3/8	0.279	0.140	7.1	U	3720	1653	930	595
				Du	0.021	0.046	0.083	0.129
				C	1860	1240	930	744
				Dc	0.017	0.037	0.066	0.103
1 1/4 x 1/4	0.305	0.191	6.1	U	4067	1807	1017	651
				Du	0.017	0.037	0.066	0.103
				C	2033	1356	1017	813
				Dc	0.013	0.030	0.053	0.083
1 1/4 x 3/8	0.436	0.273	8.6	U	5813	2584	1453	930
				Du	0.017	0.037	0.066	0.103
				C	2907	1938	1453	1163
				Dc	0.013	0.030	0.053	0.083
1 1/2 x 1/4	0.439	0.329	7.1	U	5853	2601	1463	937
				Du	0.014	0.031	0.055	0.086
				C	2927	1951	1463	1171
				Dc	0.011	0.025	0.044	0.069
1 1/2 x 3/8	0.628	0.471	10.1	U	8373	3721	2093	1340
				Du	0.014	0.031	0.055	0.086
				C	4187	2791	2093	1675
				Dc	0.011	0.025	0.044	0.069
1 3/4 x 1/4	0.598	0.523	8.1	U	7973	3544	1993	1276
				Du	0.012	0.027	0.047	0.074
				C	3987	2658	1993	1595
				Dc	0.010	0.021	0.038	0.059
1 3/4 x 3/8	0.855	0.748	11.6	U	11400	5067	2850	1824
				Du	0.012	0.027	0.047	0.074
				C	5700	3800	2850	2280
				Dc	0.010	0.021	0.038	0.059
2 x 1/4	0.781	0.781	9.1	U	10413	4628	2603	1666
				Du	0.010	0.023	0.041	0.065
				C	5207	3471	2603	2083
				Dc	0.008	0.019	0.033	0.052
2 x 3/8	1.116	1.116	13.1	U	14880	6613	3720	2381
				Du	0.010	0.023	0.041	0.065
				C	7440	4960	3720	2976
				Dc	0.008	0.019	0.033	0.052
2 1/4 x 1/4	0.988	1.111	10.1	U	13173	5855	3293	2108
				Du	0.009	0.021	0.037	0.058
				C	6587	4391	3293	2635
				Dc	0.007	0.017	0.029	0.046
2 1/4 x 3/8	1.413	1.589	14.6	U	18840	8373	4710	3014
				Du	0.009	0.021	0.037	0.058
				C	9420	6280	4710	3768
				Dc	0.007	0.017	0.029	0.046

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES

U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width				D—Deflection, Inches		
				Span in Inches						
42	48	54	60	66	72	78	84	90	96	
212	163	128	104	86	72	62	53	46	41	
0.252	0.330	0.416	0.515	0.623	0.739	0.876	1.008	1.152	1.330	
371	325	289	260	236	217	200	186	173	163	
0.202	0.264	0.334	0.412	0.497	0.594	0.696	0.808	0.925	1.057	
304	233	184	149	123	103	88	76	66	58	
0.253	0.331	0.418	0.516	0.624	0.740	0.871	1.011	1.157	1.317	
531	465	413	372	338	310	286	266	248	233	
0.202	0.264	0.334	0.412	0.499	0.594	0.696	0.809	0.928	1.058	
332	254	201	163	134	113	96	83	72	64	
0.202	0.264	0.335	0.414	0.498	0.595	0.696	0.810	0.925	1.065	
581	508	452	407	370	339	313	290	271	254	
0.162	0.211	0.268	0.331	0.400	0.476	0.559	0.647	0.743	0.845	
475	363	287	233	192	161	138	119	103	91	
0.203	0.264	0.335	0.414	0.499	0.593	0.700	0.812	0.926	1.059	
830	727	646	581	528	484	447	415	388	363	
0.162	0.212	0.268	0.330	0.400	0.475	0.558	0.647	0.744	0.845	
478	366	289	234	193	163	139	119	104	91	
0.169	0.221	0.280	0.345	0.417	0.498	0.585	0.674	0.776	0.879	
836	732	650	585	532	488	450	418	390	366	
0.135	0.177	0.224	0.276	0.334	0.398	0.466	0.541	0.621	0.707	
684	523	413	335	277	233	198	171	149	131	
0.169	0.221	0.279	0.345	0.418	0.497	0.582	0.676	0.777	0.884	
1196	1047	930	837	761	698	644	598	558	523	
0.135	0.177	0.223	0.276	0.334	0.397	0.466	0.541	0.620	0.706	
651	498	394	319	264	221	189	163	142	125	
0.145	0.189	0.240	0.296	0.358	0.425	0.501	0.581	0.667	0.760	
1139	997	886	797	725	664	613	570	532	498	
0.116	0.152	0.192	0.237	0.286	0.340	0.400	0.464	0.533	0.605	
931	713	563	456	377	317	270	233	203	178	
0.145	0.189	0.240	0.296	0.358	0.426	0.500	0.580	0.666	0.756	
1629	1425	1267	1140	1036	950	877	814	760	713	
0.116	0.151	0.192	0.237	0.286	0.341	0.400	0.463	0.532	0.606	
850	651	514	417	344	289	246	213	185	163	
0.127	0.166	0.209	0.259	0.313	0.372	0.436	0.508	0.582	0.663	
1488	1302	1157	1041	947	868	801	744	694	651	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.465	0.530	
1215	930	735	595	492	413	352	304	265	233	
0.127	0.166	0.210	0.259	0.313	0.372	0.437	0.507	0.583	0.664	
2126	1860	1653	1488	1353	1240	1145	1063	992	930	
0.101	0.132	0.168	0.207	0.250	0.298	0.350	0.406	0.466	0.530	
1075	823	651	527	435	366	312	269	234	206	
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.451	0.517	0.589	
1882	1647	1464	1317	1198	1098	1013	941	878	823	
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471	
1538	1178	930	754	623	523	446	384	335	294	
0.113	0.147	0.186	0.230	0.278	0.331	0.389	0.450	0.518	0.588	
2691	2355	2093	1884	1713	1570	1449	1346	1256	1178	
0.090	0.118	0.149	0.184	0.223	0.265	0.311	0.361	0.414	0.471	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES**

**R-37-5 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Ft. of Width (12/Ar+b)				"b"=1/4" "b"=3/8"	4.663 4.465	Allowable Rider Stress		20,000 psi	
U—Uniform Load, Pounds per Square Foot				C—Concentrated Load, Pounds per Foot of Width			D—Deflection, Inches		
Bearing Bar Size in.	Section Modulus in. <sup>3</sup> per. ft. of width	Moment Inertia in. <sup>4</sup>	Approx. Weight* lb/sqft	Span in Inches					
				12	18	24	30	36	
2 1/2 x 1/4	1.22	1.524	11.1	U	16267	7230	4067	2603	1807
				Du	0.008	0.019	0.033	0.052	0.075
				C	8133	5422	4067	3253	2711
				Dc	0.007	0.015	0.027	0.041	0.060
2 1/2 x 3/8	1.744	2.180	16.1	U	23253	10335	5813	3721	2584
				Du	0.008	0.019	0.033	0.052	0.075
				C	11627	7751	5813	4651	3876
				Dc	0.007	0.015	0.027	0.041	0.060
3 x 1/4	1.756	2.634	13.1	U	23413	10406	5853	3746	2601
				Du	0.007	0.016	0.028	0.043	0.062
				C	11707	7804	5853	4683	3902
				Dc	0.006	0.012	0.022	0.035	0.050
3 x 3/8	2.512	3.767	19.0	U	33493	14886	8373	5359	3721
				Du	0.007	0.016	0.028	0.043	0.062
				C	16747	11164	8373	6699	5582
				Dc	0.006	0.012	0.022	0.035	0.050
3 1/2 x 1/4	2.39	4.183	15.1	U	31867	14163	7967	5099	3541
				Du	0.006	0.013	0.024	0.037	0.053
				C	15933	10622	7967	6373	5311
				Dc	0.005	0.011	0.019	0.030	0.043
3 1/2 x 3/8	3.419	5.982	22.0	U	45587	20261	11397	7294	5065
				Du	0.006	0.013	0.024	0.037	0.053
				C	22793	15196	11397	9117	7598
				Dc	0.005	0.011	0.019	0.030	0.043
4 x 1/4	3.122	6.244	17.0	U	41627	18501	10407	6660	4625
				Du	0.005	0.012	0.021	0.032	0.047
				C	20813	13876	10407	8325	6938
				Dc	0.004	0.009	0.017	0.026	0.037
4 x 3/8	4.465	8.930	25.0	U	59533	26459	14883	9525	6615
				Du	0.005	0.012	0.021	0.032	0.047
				C	29767	19844	14883	11907	9922
				Dc	0.004	0.009	0.017	0.026	0.037
4 1/2 x 1/4	3.951	8.89	19.0	U	52680	23413	13170	8429	5853
				Du	0.005	0.010	0.018	0.029	0.041
				C	26340	17560	13170	10536	8780
				Dc	0.004	0.008	0.015	0.023	0.033
4 1/2 x 3/8	5.651	12.715	28.0	U	75347	33487	18837	12055	8372
				Du	0.005	0.010	0.018	0.029	0.041
				C	37673	25116	18837	15069	12558
				Dc	0.004	0.008	0.015	0.023	0.033
5 x 1/4	4.878	12.195	21.0	U	65040	28907	16260	10406	7227
				Du	0.004	0.009	0.017	0.026	0.037
				C	32520	21680	16260	13008	10840
				Dc	0.003	0.007	0.013	0.021	0.030
5 x 3/8	6.977	17.441	31.0	U	93027	41345	23257	14884	10336
				Du	0.004	0.009	0.017	0.026	0.037
				C	46513	31009	23257	18605	15504
				Dc	0.003	0.007	0.013	0.021	0.030

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.





LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width				D—Deflection, mm		
			Span in Millimeters						
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438
22	17	13	11	9	7	6	5	5	4
6.46	8.50	10.43	13.44	16.08	17.74	20.93	23.48	30.92	32.00
12	10	9	8	7	7	6	6	5	5
5.28	6.56	8.42	10.26	11.94	15.52	16.90	21.13	21.64	26.25
33	25	20	16	13	11	10	8	7	6
6.46	8.33	10.70	13.03	15.49	18.58	23.25	25.05	28.86	32.00
18	15	14	12	11	10	9	9	8	8
5.28	6.56	8.73	10.26	12.51	14.78	16.90	21.13	23.09	28.00
34	26	21	17	14	12	10	9	7	7
5.11	6.66	8.63	10.63	12.81	15.57	17.86	21.64	22.16	28.67
18	16	14	13	12	11	10	9	9	8
4.06	5.38	6.71	8.54	10.48	12.49	14.42	16.23	19.95	21.51
51	39	31	25	21	17	15	13	11	10
5.11	6.66	8.49	10.42	12.81	14.71	17.86	20.84	23.22	27.31
27	24	21	19	17	16	15	14	13	12
4.06	5.38	6.71	8.32	9.90	12.11	14.42	16.83	19.21	21.51
49	38	30	24	20	17	14	12	11	9
4.26	5.63	7.13	8.69	10.59	12.77	14.47	16.70	20.16	21.34
26	23	20	18	17	15	14	13	12	12
3.39	4.47	5.55	6.84	8.59	9.85	11.68	13.56	15.39	18.67
74	57	45	36	30	25	21	19	16	14
4.29	5.63	7.13	8.69	10.59	12.51	14.47	17.63	19.55	22.13
39	35	31	28	25	23	21	20	18	17
3.39	4.54	5.73	7.09	8.42	10.07	11.68	13.91	15.39	17.63
67	51	41	33	27	23	19	17	15	13
3.67	4.76	6.14	7.52	9.00	10.88	12.36	14.90	17.31	19.41
36	31	28	25	23	21	19	18	17	16
2.96	3.80	4.89	5.98	7.32	8.69	9.99	11.83	13.73	15.68
101	77	61	49	41	34	29	25	22	19
3.69	4.79	6.09	7.45	9.11	10.72	12.58	14.61	16.92	18.91
54	47	42	38	34	31	29	27	25	24
2.96	3.84	4.89	6.06	7.21	8.55	10.16	11.83	13.46	15.68
88	67	53	43	36	30	25	22	19	17
3.23	4.19	5.32	6.57	8.04	9.50	10.90	12.92	14.69	17.00
47	41	36	33	30	27	25	23	22	20
2.59	3.36	4.21	5.29	6.40	7.48	8.80	10.12	11.90	13.13
132	101	80	65	53	45	38	33	29	25
3.23	4.21	5.35	6.62	7.89	9.50	11.04	12.92	14.95	16.67
70	61	55	49	45	41	38	35	33	31
2.57	3.34	4.29	5.24	6.40	7.57	8.92	10.27	11.90	13.56
111	85	67	54	45	38	32	28	24	21
2.86	3.73	4.72	5.79	7.06	8.45	9.80	11.54	13.03	14.75
59	52	46	41	38	35	32	30	28	26
2.28	3.00	3.78	4.62	5.69	6.81	7.91	9.27	10.64	11.99
167	128	101	82	68	57	48	42	36	32
2.87	3.75	4.74	5.86	7.11	8.45	9.80	11.54	13.03	14.98
89	78	69	62	57	52	48	44	41	39
2.29	3.00	3.78	4.65	5.69	6.75	7.91	9.07	10.39	11.99

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**W-19-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width		10.10	Allowable Fiber Stress						
No. Bars/Meter of Width		33.15							
U—Uniform Load, kPa			C—Concentrated Load, N/mm of width					D—Deflection, mm	
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia Approx. Wr*(Kg)/ Sq. meter		Span in Millimeters					
				305	457	610	762	914	
64 x 6.4  (2½ x 1¼)	43 100	1 369 000	110	U	1678	747	419	269	187
				Du	0.21	0.47	0.84	1.31	1.89
				C	256	171	128	102	85
				Dc	0.17	0.38	0.67	1.05	1.51
64 x 9.5  (2½ x 3/8)	64 700	2 054 000	163	U	2517	1121	629	403	280
				Du	0.21	0.47	0.84	1.31	1.89
				C	384	256	192	154	128
				Dc	0.17	0.38	0.67	1.05	1.51
76 x 6.4  (3 x 1¼)	62 100	2 366 000	131	U	2416	1076	604	387	269
				Du	0.18	0.39	0.70	1.09	1.57
				C	368	246	184	147	123
				Dc	0.14	0.32	0.56	0.87	1.26
76 x 9.5  (3 x 3/8)	93 100	3 549 000	194	U	3624	1614	906	581	404
				Du	0.18	0.39	0.70	1.10	1.58
				C	553	369	276	221	184
				Dc	0.14	0.32	0.56	0.87	1.26
89 x 6.4  (3½ x 1¼)	84 500	3 757 000	152	U	3289	1465	822	527	366
				Du	0.15	0.34	0.60	0.94	1.35
				C	502	335	251	201	167
				Dc	0.12	0.27	0.48	0.75	1.08
89 x 9.5  (3½ x 3/8)	126 800	5 635 000	226	U	4933	2197	1233	790	549
				Du	0.15	0.34	0.60	0.94	1.35
				C	752	502	376	301	251
				Dc	0.12	0.27	0.48	0.75	1.08
102 x 6.4  (4 x 1¼)	110 400	5 608 000	173	U	4295	1913	1074	688	478
				Du	0.13	0.30	0.53	0.82	1.18
				C	655	437	328	262	219
				Dc	0.11	0.24	0.42	0.66	0.95
102 x 9.5  (4 x 3/8)	165 600	8 412 000	257	U	6443	2870	1611	1032	717
				Du	0.13	0.30	0.53	0.82	1.18
				C	983	656	491	393	328
				Dc	0.11	0.24	0.42	0.66	0.95
114 x 6.4  (4½ x 1¼)	139 700	7 985 000	194	U	5436	2421	1359	871	605
				Du	0.12	0.26	0.47	0.73	1.05
				C	829	553	415	332	277
				Dc	0.09	0.21	0.37	0.58	0.84
114 x 9.5  (4½ x 3/8)	209 600	11 977 000	288	U	8154	3632	2039	1306	908
				Du	0.12	0.26	0.47	0.73	1.05
				C	1244	830	622	498	415
				Dc	0.09	0.21	0.37	0.58	0.84
127 x 6.4  (5 x 1¼)	172 500	10 953 000	215	U	6711	2989	1678	1075	747
				Du	0.11	0.24	0.42	0.66	0.94
				C	1023	683	512	410	342
				Dc	0.08	0.19	0.34	0.53	0.76
127 x 9.5  (5 x 3/8)	258 700	16 430 000	320	U	10067	4484	2517	1613	1121
				Du	0.11	0.24	0.42	0.66	0.94
				C	1535	1025	768	614	512
				Dc	0.08	0.19	0.34	0.52	0.76

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
137	105	83	67	56	47	40	34	30	26	
2.57	3.36	4.26	5.24	6.40	7.62	8.93	10.22	11.87	13.31	
73	64	57	51	47	43	39	37	34	32	
2.06	2.69	3.41	4.19	5.13	6.10	7.03	8.34	9.42	10.75	
206	158	124	101	83	70	60	51	45	39	
2.58	3.37	4.25	5.26	6.33	7.57	8.93	10.22	11.87	13.31	
110	96	85	77	70	64	59	55	51	48	
2.07	2.69	3.39	4.21	5.09	6.05	7.09	8.26	9.42	10.75	
197	151	119	97	80	67	57	49	43	38	
2.14	2.80	3.54	4.39	5.29	6.29	7.36	8.52	9.85	11.26	
105	92	82	74	67	61	57	53	49	46	
1.71	2.24	2.84	3.52	4.23	5.01	5.95	6.91	7.86	8.95	
296	227	179	145	120	101	86	74	65	57	
2.15	2.80	3.55	4.37	5.29	6.32	7.41	8.58	9.93	11.26	
158	138	123	111	101	92	85	79	74	69	
1.72	2.24	2.84	3.52	4.25	5.04	5.91	6.87	7.91	8.95	
269	206	163	132	109	91	78	67	59	51	
1.84	2.40	3.05	3.76	4.54	5.38	6.34	7.34	8.51	9.52	
143	125	111	100	91	84	77	72	67	63	
1.47	1.91	2.42	2.99	3.62	4.34	5.06	5.91	6.76	7.72	
403	309	244	198	163	137	117	101	88	77	
1.84	2.40	3.04	3.76	4.53	5.40	6.34	7.38	8.46	9.58	
215	188	167	151	137	125	116	108	100	94	
1.47	1.92	2.43	3.01	3.63	4.31	5.08	5.91	6.73	7.67	
351	269	212	172	142	119	102	88	76	67	
1.61	2.10	2.66	3.28	3.96	4.71	5.56	6.46	7.34	8.38	
187	164	146	131	119	109	101	94	87	82	
1.29	1.68	2.13	2.63	3.17	3.78	4.45	5.17	5.88	6.73	
526	403	318	258	213	179	153	132	115	101	
1.61	2.10	2.66	3.28	3.96	4.73	5.56	6.46	7.41	8.42	
281	246	218	197	179	164	151	140	131	123	
1.29	1.68	2.13	2.63	3.18	3.79	4.43	5.14	5.91	6.73	
444	340	269	218	180	151	129	111	97	85	
1.43	1.87	2.37	2.92	3.53	4.20	4.94	5.72	6.58	7.46	
237	207	184	166	151	138	128	118	111	104	
1.14	1.49	1.89	2.34	2.83	3.36	3.96	4.56	5.27	5.99	
666	510	403	327	270	227	193	167	145	128	
1.43	1.87	2.37	2.92	3.53	4.21	4.92	5.74	6.56	7.49	
355	311	276	249	226	207	191	178	166	156	
1.14	1.49	1.89	2.34	2.82	3.36	3.94	4.59	5.26	5.99	
548	420	332	269	222	187	159	137	119	105	
1.29	1.68	2.13	2.63	3.17	3.79	4.44	5.15	5.89	6.72	
293	256	228	205	186	171	158	146	137	128	
1.03	1.34	1.71	2.10	2.54	3.03	3.56	4.11	4.74	5.38	
823	630	497	403	333	280	239	206	179	158	
1.29	1.68	2.13	2.63	3.17	3.78	4.45	5.16	5.90	6.74	
439	384	341	307	279	256	236	219	205	192	
1.03	1.34	1.70	2.10	2.54	3.03	3.55	4.11	4.73	5.38	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.



LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
19	15	11	9	8	6	5	5	4	4	
6.46	8.69	10.22	12.73	16.55	17.61	20.19	27.19	28.64	37.06	
10	9	8	7	6	6	5	5	5	4	
5.10	6.84	8.67	10.40	11.85	15.40	16.31	20.39	25.06	24.32	
28	22	17	14	12	10	8	7	6	5	
6.34	8.49	10.53	13.20	16.55	19.56	21.54	25.38	28.64	30.88	
15	13	12	11	10	9	8	8	7	7	
5.10	6.59	8.67	10.89	13.17	15.40	17.40	21.75	23.39	28.37	
30	23	18	15	12	10	9	7	6	6	
5.22	6.82	8.56	10.86	12.71	15.02	18.61	19.49	22.00	28.46	
16	14	12	11	10	9	9	8	7	7	
4.18	5.45	6.66	8.36	10.11	11.83	15.03	16.70	17.96	21.79	
44	34	27	22	18	15	13	11	10	9	
5.10	6.72	8.56	10.62	12.71	15.02	17.92	20.42	24.44	28.46	
24	21	18	17	15	14	13	12	11	10	
4.18	5.45	6.66	8.62	10.11	12.27	14.47	16.70	18.82	20.75	
43	33	26	21	17	15	12	11	9	8	
4.33	5.66	7.16	8.80	10.42	13.04	14.36	17.72	19.10	21.96	
23	20	18	16	14	13	12	11	11	10	
3.47	4.50	5.78	7.04	8.19	9.89	11.60	13.29	16.34	18.01	
64	49	39	31	26	22	19	16	14	12	
4.30	5.60	7.16	8.66	10.63	12.75	15.16	17.19	19.80	21.96	
34	30	27	24	22	20	18	17	16	15	
3.42	4.50	5.78	7.04	8.58	10.14	11.60	13.69	15.84	18.01	
58	44	35	28	24	20	17	15	13	11	
3.68	4.75	6.07	7.39	9.27	10.95	12.81	15.22	17.37	19.01	
31	27	24	22	20	18	17	15	14	14	
2.95	3.83	4.85	6.10	7.37	8.62	10.35	11.41	13.09	15.88	
87	67	53	43	35	30	25	22	19	17	
3.68	4.83	6.13	7.57	9.01	10.95	12.56	14.88	16.92	19.59	
46	41	36	33	30	27	25	23	22	20	
2.92	3.88	4.85	6.10	7.37	8.62	10.14	11.67	13.72	15.13	
76	58	46	37	31	26	22	19	17	15	
3.23	4.20	5.34	6.54	8.02	9.54	11.11	12.92	15.22	17.37	
40	35	31	28	26	24	22	20	19	18	
2.55	3.32	4.20	5.20	6.42	7.70	8.97	10.19	11.90	13.68	
114	87	69	56	46	39	33	28	25	22	
3.23	4.20	5.34	6.60	7.93	9.54	11.11	12.69	14.92	16.98	
61	53	47	42	39	35	33	30	28	27	
2.59	3.36	4.24	5.20	6.42	7.49	8.97	10.19	11.69	13.68	
96	73	58	47	39	33	28	24	21	18	
2.86	3.71	4.73	5.84	7.08	8.50	9.93	11.46	13.20	14.64	
51	45	40	36	33	30	28	26	24	22	
2.28	3.00	3.81	4.69	5.72	6.76	8.02	9.31	10.56	11.74	
144	110	87	71	58	49	42	36	31	28	
2.86	3.73	4.73	5.88	7.02	8.42	9.93	11.46	12.99	15.18	
77	67	60	54	49	45	41	38	36	34	
2.30	2.98	3.81	4.69	5.66	6.76	7.83	9.07	10.56	12.10	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**W-22-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width	8.727	Allowable Fiber Stress							
No. Bars/Meter of Width	28.63								
<b>U—Uniform Load, kPa</b>	<b>C—Concentrated Load, N/mm of width</b>					<b>D—Deflection,mm</b>			
<b>Bearing Bar Size mm (inches)</b>	<b>Section Modulus per. ft.(304.8mm) width</b>	<b>Moment Inertia</b>	<b>Approx. Wt.(Kg)/ Sq. meter</b>	<b>Span in Millimeters</b>					
				<b>305</b>	<b>457</b>	<b>610</b>	<b>762</b>	<b>914</b>	
64 x 6.4  (2½ x 1¼)	37 240	1 182 000	96	U	1449	645	362	232	161
				Du	0.21	0.47	0.84	1.31	1.89
				C	221	147	110	88	74
				Dc	0.17	0.38	0.67	1.05	1.52
64 x 9.5  (2½ x 3/8)	55 900	1 774 000	141	U	2174	968	543	348	242
				Du	0.21	0.47	0.84	1.31	1.89
				C	331	221	166	133	111
				Dc	0.17	0.38	0.67	1.05	1.52
76 x 6.4  (3 x 1¼)	53 600	2 043 000	114	U	2087	929	522	334	232
				Du	0.18	0.39	0.70	1.09	1.57
				C	318	212	159	127	106
				Dc	0.14	0.31	0.56	0.87	1.26
76 x 9.5  (3 x 3/8)	80 400	3 065 000	168	U	3130	1394	782	501	349
				Du	0.18	0.39	0.70	1.09	1.58
				C	477	319	239	191	159
				Dc	0.14	0.32	0.56	0.88	1.26
89 x 6.4  (3½ x 1¼)	73 000	3 245 000	132	U	2840	1265	710	455	316
				Du	0.15	0.34	0.60	0.94	1.35
				C	433	289	217	173	145
				Dc	0.12	0.27	0.48	0.75	1.08
89 x 9.5  (3½ x 3/8)	109 500	4 867 000	196	U	4260	1898	1065	683	474
				Du	0.15	0.34	0.60	0.94	1.35
				C	650	434	325	260	217
				Dc	0.12	0.27	0.48	0.75	1.08
102 x 6.4  (4 x 1¼)	95 300	4 843 000	150	U	3709	1652	927	594	413
				Du	0.13	0.30	0.53	0.82	1.18
				C	566	378	283	226	189
				Dc	0.11	0.24	0.42	0.66	0.95
102 x 9.5  (4 x 3/8)	143 000	7 265 000	223	U	5564	2478	1391	891	620
				Du	0.13	0.30	0.53	0.82	1.18
				C	849	566	424	340	283
				Dc	0.11	0.24	0.42	0.66	0.94
114 x 6.4  (4½ x 1¼)	120 700	6 896 000	168	U	4695	2091	1174	752	523
				Du	0.12	0.26	0.47	0.73	1.05
				C	716	478	358	287	239
				Dc	0.09	0.21	0.37	0.58	0.84
114 x 9.5  (4½ x 3/8)	181 000	10 344 000	250	U	7042	3137	1761	1128	784
				Du	0.12	0.26	0.47	0.73	1.05
				C	1074	717	537	430	358
				Dc	0.09	0.21	0.37	0.58	0.84
127 x 6.4  (5 x 1¼)	149 000	9 460 000	186	U	5796	2582	1449	929	645
				Du	0.11	0.24	0.42	0.66	0.94
				C	884	590	442	354	295
				Dc	0.08	0.19	0.34	0.53	0.76
127 x 9.5  (5 x 3/8)	233 500	14 189 000	277	U	8694	3873	2174	1393	968
				Du	0.11	0.24	0.42	0.66	0.94
				C	1326	885	663	531	442
				Dc	0.08	0.19	0.34	0.53	0.76

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width				D—Deflection, mm		
			Span in Millimeters						
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438
118	91	72	58	48	40	34	30	26	23
2.57	3.37	4.28	5.25	6.36	7.51	8.79	10.44	11.92	13.64
63	55	49	44	40	37	34	32	29	28
2.05	2.68	3.40	4.18	5.06	6.08	7.10	8.35	9.30	10.89
178	136	107	87	72	60	52	44	39	34
2.58	3.36	4.24	5.25	6.36	7.51	8.96	10.21	11.92	13.44
95	83	74	66	60	55	51	47	44	41
2.07	2.69	3.42	4.18	5.06	6.02	7.10	8.18	9.41	10.64
170	131	103	84	69	58	49	43	37	33
2.14	2.81	3.54	4.40	5.29	6.30	7.33	8.66	9.81	11.32
91	80	71	64	58	53	49	45	42	40
1.72	2.25	2.85	3.52	4.24	5.04	5.92	6.80	7.80	9.01
256	196	155	125	104	87	74	64	56	49
2.15	2.80	3.56	4.37	5.31	6.30	7.38	8.59	9.90	11.21
136	119	106	96	87	80	73	68	64	60
1.71	2.23	2.84	3.52	4.24	5.07	5.88	6.85	7.92	9.01
232	178	140	114	94	79	67	58	51	44
1.84	2.40	3.03	3.76	4.54	5.41	6.31	7.36	8.52	9.51
124	108	96	87	79	72	67	62	58	54
1.47	1.91	2.43	3.01	3.64	4.31	5.10	5.90	6.78	7.66
348	267	211	171	141	118	101	87	76	67
1.84	2.40	3.05	3.76	4.54	5.38	6.34	7.36	8.46	9.65
186	163	144	130	118	108	100	93	87	81
1.47	1.93	2.43	3.00	3.62	4.31	5.07	5.90	6.78	7.66
303	232	183	149	123	103	88	76	66	58
1.61	2.10	2.66	3.29	3.98	4.72	5.55	6.46	7.38	8.40
162	142	126	113	103	94	87	81	75	71
1.29	1.69	2.13	2.62	3.18	3.77	4.43	5.16	5.87	6.74
455	348	275	223	184	155	132	114	99	87
1.61	2.10	2.66	3.29	3.97	4.74	5.55	6.46	7.38	8.40
243	212	189	170	154	142	131	121	113	106
1.29	1.68	2.13	2.63	3.17	3.80	4.45	5.14	5.90	6.71
384	294	232	188	155	131	111	96	84	73
1.43	1.87	2.37	2.92	3.52	4.22	4.92	5.73	6.60	7.42
205	179	159	143	130	119	110	102	96	90
1.15	1.49	1.89	2.33	2.82	3.35	3.94	4.56	5.28	6.00
575	441	348	282	233	196	167	144	125	110
1.43	1.87	2.37	2.92	3.53	4.21	4.93	5.73	6.55	7.46
307	269	239	215	195	179	165	153	143	134
1.14	1.50	1.89	2.34	2.82	3.36	3.94	4.56	5.24	5.96
474	363	286	232	192	161	137	118	103	91
1.29	1.68	2.13	2.63	3.18	3.78	4.43	5.13	5.90	6.74
253	221	196	177	161	147	136	126	118	111
1.03	1.34	1.70	2.10	2.54	3.02	3.55	4.11	4.73	5.40
710	544	430	348	288	242	206	178	155	136
1.29	1.68	2.13	2.63	3.18	3.79	4.44	5.16	5.92	6.72
379	332	295	265	241	221	204	189	177	166
1.03	1.35	1.70	2.10	2.54	3.03	3.55	4.11	4.73	5.38

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**W-30-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width		6.400	Allowable Fiber Stress					
No. Bars/Meter of Width		20.99						
U—Uniform Load, kPa			C—Concentrated Load, N/mm of width				D—Deflection,mm	
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia	Approx. Wt*(Kg)/ Sq. meter	Span in Millimeters				
				305	457	610	762	914
25 x 6.4 (1 x 1/4)	4 370	55 500	32	U 170	76	43	27	19
				Du 0.53	1.19	2.13	3.25	4.74
				C 26	17	13	10	9
				Dc 0.42	0.93	1.69	2.53	3.93
25 x 9.5 (1 x 3/8)	6 550	83 200	45	U 255	114	64	41	28
				Du 0.53	1.19	2.11	3.30	4.66
				C 39	26	19	16	13
				Dc 0.42	0.95	1.64	2.70	3.79
32 x 6.4 (1 1/4 x 1/4)	6 830	108 400	39	U 266	118	66	43	30
				Du 0.42	0.94	1.67	2.65	3.83
				C 41	27	20	16	14
				Dc 0.34	0.75	1.33	2.07	3.13
32 x 9.5 (1 1/4 x 3/8)	10 240	162 600	55	U 398	177	100	64	44
				Du 0.42	0.94	1.69	2.63	3.75
				C 61	41	30	24	20
				Dc 0.34	0.76	1.33	2.07	2.98
38 x 6.4 (1 1/2 x 1/4)	9 830	187 300	45	U 383	170	96	61	43
				Du 0.35	0.79	1.41	2.18	3.18
				C 58	39	29	23	19
				Dc 0.28	0.63	1.12	1.73	2.46
38 x 9.5 (1 1/2 x 3/8)	14 750	281 000	65	U 574	256	143	92	64
				Du 0.35	0.79	1.40	2.19	3.15
				C 88	58	44	35	29
				Dc 0.28	0.63	1.13	1.75	2.50
44 x 6.4 (1 3/4 x 1/4)	13 380	297 400	52	U 521	232	130	83	58
				Du 0.30	0.68	1.20	1.87	2.70
				C 79	53	40	32	26
				Dc 0.24	0.54	0.97	1.51	2.12
44 x 9.5 (1 3/4 x 3/8)	20 070	446 100	75	U 781	348	195	125	87
				Du 0.30	0.68	1.20	1.87	2.70
				C 119	79	60	48	40
				Dc 0.24	0.54	0.97	1.51	2.17
51 x 6.4 (2 x 1/4)	17 480	444 000	59	U 680	303	170	109	76
				Du 0.26	0.59	1.05	1.64	2.37
				C 104	69	52	42	35
				Dc 0.21	0.47	0.84	1.33	1.91
51 x 9.5 (2 x 3/8)	26 220	666 000	85	U 1020	454	255	163	114
				Du 0.26	0.59	1.05	1.64	2.37
				C 156	104	78	62	52
				Dc 0.21	0.47	0.84	1.31	1.89
57 x 6.4 (2 1/4 x 1/4)	22 120	632 200	65	U 861	383	215	138	96
				Du 0.23	0.52	0.93	1.46	2.10
				C 131	88	66	53	44
				Dc 0.19	0.42	0.75	1.18	1.69
57 x 9.5 (2 1/4 x 3/8)	33 180	948 200	95	U 1291	575	323	207	144
				Du 0.23	0.52	0.94	1.46	2.10
				C 197	131	98	79	66
				Dc 0.19	0.42	0.74	1.17	1.69

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

**LOAD  
TABLES  
(METRIC)**

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width					D—Deflection, mm		
			Span in Millimeters							
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
14	11	8	7	6	5	4	3	3	3	
6.49	8.68	10.14	13.50	16.93	20.01	22.03	22.25	29.29	37.90	
7	6	6	5	5	4	4	4	3	3	
4.86	6.22	8.87	10.13	13.47	14.00	17.79	22.24	20.50	24.87	
21	16	13	10	8	7	6	5	5	4	
6.49	8.42	10.98	12.86	15.05	18.67	22.03	24.72	32.55	33.69	
11	10	9	8	7	6	6	6	5	5	
5.10	6.91	8.87	10.80	12.57	14.00	17.79	22.24	22.78	27.63	
22	17	13	11	9	7	6	5	5	4	
5.22	6.87	8.43	10.86	13.00	14.34	16.92	18.98	25.00	25.87	
12	10	9	8	7	7	6	6	5	5	
4.27	5.31	6.81	8.29	9.65	12.55	13.66	17.08	17.50	21.22	
33	25	20	16	13	11	9	8	7	6	
5.22	6.74	8.65	10.53	12.52	15.02	16.92	20.25	23.33	25.87	
17	15	14	12	11	10	9	9	8	8	
4.03	5.31	7.06	8.29	10.11	11.95	13.66	17.08	18.66	22.64	
31	24	19	15	13	11	9	8	7	6	
4.26	5.61	7.13	8.57	10.87	13.04	14.68	17.58	20.25	22.46	
17	15	13	12	11	10	9	8	8	7	
3.50	4.61	5.69	7.20	8.78	10.37	11.86	13.18	16.20	17.19	
47	36	28	23	19	16	14	12	10	9	
4.30	5.61	7.01	8.76	10.59	12.65	15.23	17.58	19.29	22.46	
25	22	19	18	16	15	13	13	12	11	
3.43	4.50	5.55	7.20	8.51	10.37	11.42	14.28	16.20	18.01	
43	33	26	21	17	14	12	11	9	8	
3.72	4.86	6.15	7.56	8.95	10.45	12.33	15.22	16.40	18.86	
23	20	18	16	14	13	12	11	11	10	
2.98	3.87	4.96	6.05	7.04	8.49	9.96	11.41	14.03	15.47	
64	49	39	31	26	22	19	16	14	12	
3.69	4.81	6.15	7.44	9.12	10.95	13.01	14.76	17.01	18.86	
34	30	26	24	22	20	18	17	16	15	
2.94	3.87	4.78	6.05	7.37	8.71	9.96	11.76	13.60	15.47	
56	43	34	27	23	19	16	14	12	11	
3.24	4.24	5.38	6.51	8.11	9.50	11.01	12.98	14.65	17.37	
30	26	23	21	19	17	16	15	14	13	
2.61	3.37	4.25	5.32	6.40	7.44	8.90	10.42	11.96	13.47	
83	64	50	41	34	28	24	21	18	16	
3.21	4.21	5.28	6.59	7.99	9.34	11.01	12.98	14.65	16.84	
44	39	35	31	28	26	24	22	21	19	
2.55	3.37	4.31	5.23	6.28	7.58	8.90	10.19	11.96	13.13	
70	54	43	34	29	24	20	18	15	13	
2.85	3.74	4.78	5.76	7.18	8.43	9.67	11.72	12.86	14.42	
38	33	29	26	24	22	20	19	18	16	
2.32	3.00	3.76	4.62	5.67	6.76	7.81	9.27	10.80	11.65	
105	81	64	52	43	36	31	26	23	20	
2.85	3.74	4.75	5.87	7.10	8.43	9.99	11.28	13.14	14.79	
56	49	44	39	36	33	30	28	26	25	
2.28	2.97	3.80	4.62	5.67	6.76	7.81	9.11	10.40	12.13	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.



LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
87	67	53	43	35	30	25	22	19	17	
2.58	3.39	4.30	5.31	6.32	7.68	8.81	10.44	11.87	13.74	
46	41	36	32	29	27	25	23	22	20	
2.05	2.72	3.40	4.15	5.00	6.05	7.12	8.18	9.62	10.61	
130	100	79	64	53	44	38	33	28	25	
2.57	3.37	4.27	5.27	6.38	7.51	8.93	10.44	11.67	13.47	
69	61	54	49	44	41	37	35	32	30	
2.05	2.70	3.40	4.23	5.06	6.12	7.02	8.30	9.33	10.61	
125	96	76	61	51	43	36	31	27	24	
2.15	2.81	3.57	4.36	5.33	6.37	7.34	8.51	9.76	11.23	
67	58	52	47	42	39	36	33	31	29	
1.72	2.23	2.85	3.53	4.19	5.06	5.93	6.80	7.85	8.90	
188	144	113	92	76	64	54	47	41	36	
2.15	2.81	3.54	4.38	5.29	6.32	7.34	8.61	9.89	11.23	
100	88	78	70	64	58	54	50	47	44	
1.72	2.25	2.85	3.50	4.26	5.01	5.93	6.86	7.93	9.01	
170	130	103	83	69	58	49	43	37	33	
1.84	2.39	3.04	3.73	4.54	5.41	6.29	7.44	8.43	9.72	
91	79	71	64	58	53	49	45	42	40	
1.48	1.91	2.45	3.02	3.64	4.33	5.08	5.84	6.69	7.73	
255	196	154	125	103	87	74	64	56	49	
1.84	2.41	3.03	3.75	4.52	5.41	6.34	7.38	8.50	9.62	
136	119	106	95	87	79	73	68	64	60	
1.47	1.92	2.44	2.99	3.64	4.30	5.05	5.88	6.80	7.73	
222	170	134	109	90	76	64	56	48	43	
1.61	2.10	2.65	3.29	3.97	4.75	5.51	6.49	7.32	8.49	
119	104	92	83	75	69	64	59	55	52	
1.29	1.68	2.12	2.63	3.16	3.77	4.45	5.13	5.87	6.74	
333	255	202	163	135	113	97	83	73	64	
1.61	2.10	2.67	3.27	3.97	4.71	5.56	6.41	7.43	8.42	
178	156	138	125	113	104	96	89	83	78	
1.29	1.68	2.12	2.64	3.17	3.79	4.45	5.15	5.91	6.74	
281	216	170	138	114	96	82	70	61	54	
1.43	1.87	2.36	2.92	3.53	4.22	4.96	5.70	6.54	7.49	
150	131	117	105	96	88	81	75	70	66	
1.14	1.49	1.90	2.33	2.84	3.38	3.95	4.58	5.25	6.00	
422	323	255	207	171	144	122	105	92	81	
1.43	1.87	2.36	2.92	3.53	4.22	4.91	5.70	6.57	7.49	
225	197	175	158	143	131	121	113	105	99	
1.14	1.49	1.89	2.34	2.82	3.35	3.94	4.60	5.25	6.00	
347	266	210	170	141	118	101	87	76	67	
1.29	1.68	2.13	2.62	3.18	3.78	4.45	5.16	5.94	6.77	
185	162	144	130	118	108	100	93	86	81	
1.03	1.34	1.70	2.11	2.54	3.02	3.56	4.14	4.70	5.37	
521	399	315	255	211	177	151	130	113	100	
1.29	1.68	2.13	2.62	3.17	3.78	4.43	5.14	5.88	6.74	
278	243	216	195	177	162	150	139	130	122	
1.03	1.34	1.70	2.11	2.54	3.02	3.56	4.12	4.74	5.39	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.



**LOAD  
TABLES  
(METRIC)**

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width					D—Deflection, mm		
			Span in Millimeters							
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
11	8	7	5	4	4	3	3	2	2	
6.46	8.00	11.23	12.21	14.29	20.27	20.92	28.18	24.74	32.00	
6	5	5	4	4	3	3	3	3	3	
5.28	6.56	9.36	10.26	13.65	13.30	16.90	21.13	25.97	31.50	
16	13	10	8	7	6	5	4	4	3	
6.26	8.67	10.70	13.03	16.68	20.27	23.25	25.05	32.98	32.00	
9	8	7	6	6	5	5	4	4	4	
5.28	7.00	8.73	10.26	13.65	14.78	18.78	18.78	23.08	28.00	
17	13	10	8	7	6	5	4	4	3	
5.11	6.66	8.22	10.01	12.81	15.57	17.85	19.23	25.33	24.58	
9	8	7	6	6	5	5	5	4	4	
4.06	5.38	6.71	7.88	10.48	11.35	14.42	18.03	17.73	21.50	
26	20	16	13	10	9	7	6	6	5	
5.21	6.83	8.76	10.84	12.20	15.57	16.66	19.23	25.33	27.31	
14	12	11	10	9	8	7	7	6	6	
4.21	5.38	7.03	8.75	10.48	12.11	13.46	16.83	17.73	21.50	
25	19	15	12	10	8	7	6	5	5	
4.35	5.63	7.13	8.69	10.59	12.01	14.47	16.70	18.32	23.70	
13	12	10	9	8	8	7	7	6	6	
3.39	4.67	5.54	6.84	8.09	10.51	11.68	14.61	15.39	18.67	
37	28	22	18	15	13	11	9	8	7	
4.29	5.53	6.97	8.69	10.59	13.01	15.15	16.70	19.54	22.12	
20	17	15	14	13	12	11	10	9	9	
3.48	4.41	5.54	7.09	8.76	10.51	12.24	13.91	15.39	18.67	
34	26	20	16	14	11	10	8	7	6	
3.72	4.85	5.99	7.29	9.33	10.40	13.01	14.02	16.15	17.91	
18	16	14	13	11	10	10	9	8	8	
2.96	3.92	4.89	6.22	7.00	8.27	10.51	11.83	12.92	15.67	
50	39	30	25	20	17	15	13	11	10	
3.65	4.85	5.99	7.60	8.89	10.72	13.01	15.19	16.92	19.90	
27	24	21	19	17	16	14	13	13	12	
2.96	3.92	4.89	6.06	7.21	8.82	9.81	11.39	14.00	15.67	
44	34	27	22	18	15	13	11	10	8	
3.23	4.25	5.42	6.72	8.04	9.50	11.33	12.91	15.46	16.00	
23	20	18	16	15	14	13	12	11	10	
2.53	3.28	4.21	5.13	6.40	7.76	9.15	10.56	11.90	13.13	
66	50	40	32	27	22	19	16	14	13	
3.23	4.17	5.35	6.51	8.04	9.29	11.04	12.52	14.43	17.33	
35	31	27	25	22	20	19	18	16	15	
2.57	3.39	4.21	5.34	6.25	7.39	8.92	10.56	11.54	13.13	
56	43	34	27	23	19	16	14	12	11	
2.89	3.77	4.79	5.79	7.22	8.45	9.80	11.54	13.03	15.45	
30	26	23	21	19	17	16	15	14	13	
2.32	3.00	3.78	4.73	5.69	6.62	7.91	9.27	10.64	11.98	
83	64	50	41	34	28	24	21	18	16	
2.85	3.75	4.70	5.86	7.11	8.31	9.80	11.54	13.03	14.98	
44	39	35	31	28	26	24	22	21	19	
2.27	3.00	3.83	4.65	5.59	6.75	7.91	9.07	10.64	11.68	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**W-38-4 HEAVY DUTY WELDED STEEL GRATING**

No. Bars/Ft. of Width 5.053 No. Bars/Meter of Width 16.57				Allowable Fiber Stress					
U—Uniform Load, kPa				C—Concentrated Load, N/mm of width			D—Deflection, mm		
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia	Approx. Wt*(Kg)/ Sq. meter	Span in Millimeters					
				305	457	610	762	914	
64 x 6.4  (2½ x 1¼)	21 560	685 000	58	U	839	374	210	134	93
				Du	0.21	0.47	0.84	1.31	1.88
				C	128	85	64	51	43
				Dc	0.17	0.38	0.67	1.05	1.52
64 x 9.5  (2½ x 3/8)	32 350	1 027 000	84	U	1258	561	315	202	140
				Du	0.21	0.47	0.84	1.32	1.89
				C	192	128	96	77	64
				Dc	0.17	0.38	0.67	1.05	1.51
76 x 6.4  (3 x 1¼)	31 050	1 183 000	68	U	1208	538	302	194	135
				Du	0.18	0.39	0.70	1.10	1.58
				C	184	123	92	74	61
				Dc	0.14	0.32	0.56	0.88	1.25
76 x 9.5  (3 x 3/8)	46 600	1 775 000	100	U	1812	807	453	290	202
				Du	0.18	0.39	0.70	1.09	1.58
				C	276	184	138	111	92
				Dc	0.14	0.31	0.56	0.88	1.26
89 x 6.4  (3½ x 1¼)	42 300	1 879 000	79	U	1644	732	411	263	183
				Du	0.15	0.34	0.60	0.94	1.35
				C	251	167	125	100	84
				Dc	0.12	0.27	0.48	0.75	1.08
89 x 9.5  (3½ x 3/8)	63 400	2 818 000	116	U	2467	1099	617	395	275
				Du	0.15	0.34	0.60	0.94	1.35
				C	376	251	188	151	126
				Dc	0.12	0.27	0.48	0.75	1.08
102 x 6.4  (4 x 1¼)	55 200	2 804 000	89	U	2148	957	537	344	239
				Du	0.13	0.30	0.53	0.82	1.18
				C	328	219	164	131	109
				Dc	0.11	0.24	0.42	0.66	0.94
102 x 9.5  (4 x 3/8)	82 800	4 206 000	131	U	3222	1435	805	516	359
				Du	0.13	0.30	0.53	0.82	1.18
				C	491	328	246	197	164
				Dc	0.11	0.24	0.42	0.66	0.95
114 x 6.4  (4½ x 1¼)	69 900	3 993 000	100	U	2718	1211	680	436	303
				Du	0.12	0.26	0.47	0.73	1.05
				C	415	277	207	166	138
				Dc	0.09	0.21	0.37	0.58	0.84
114 x 9.5  (4½ x 3/8)	104 800	5 989 000	147	U	4078	1816	1019	653	454
				Du	0.12	0.26	0.47	0.73	1.05
				C	622	415	311	249	208
				Dc	0.09	0.21	0.37	0.58	0.84
127 x 6.4  (5 x 1¼)	86 300	5 477 000	110	U	3356	1495	839	538	374
				Du	0.11	0.24	0.42	0.66	0.95
				C	512	342	256	205	171
				Dc	0.08	0.19	0.34	0.53	0.76
127 x 9.5  (5 x 3/8)	129 400	8 216 000	163	U	5034	2242	1258	806	561
				Du	0.11	0.24	0.42	0.66	0.95
				C	768	512	384	307	256
				Dc	0.08	0.19	0.34	0.52	0.76

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width					D—Deflection, mm		
			Span in Millimeters							
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
69	53	41	34	28	23	20	17	15	13	
2.59	3.39	4.21	5.32	6.40	7.46	8.93	10.22	11.87	13.31	
37	32	28	26	23	21	20	18	17	16	
2.08	2.69	3.35	4.27	5.02	5.96	7.21	8.11	9.42	10.75	
103	79	62	50	42	35	30	26	22	20	
2.58	3.37	4.24	5.21	6.40	7.57	8.93	10.42	11.61	13.65	
55	48	43	38	35	32	30	27	26	24	
2.07	2.69	3.43	4.16	5.09	6.05	7.21	8.11	9.60	10.75	
99	76	60	48	40	34	29	25	22	19	
2.15	2.81	3.57	4.34	5.29	6.38	7.49	8.70	10.08	11.26	
53	46	41	37	34	31	28	26	25	23	
1.73	2.24	2.84	3.51	4.30	5.09	5.84	6.78	8.02	8.94	
148	113	90	73	60	50	43	37	32	28	
2.15	2.79	3.57	4.40	5.29	6.26	7.41	8.58	9.77	11.06	
79	69	61	55	50	46	43	39	37	35	
1.72	2.24	2.82	3.48	4.21	5.04	5.98	6.78	7.91	9.07	
134	103	81	66	54	46	39	34	29	26	
1.83	2.40	3.03	3.76	4.50	5.44	6.34	7.45	8.37	9.70	
72	63	56	50	46	42	39	36	33	31	
1.48	1.93	2.44	2.99	3.66	4.34	5.12	5.91	6.66	7.59	
202	154	122	99	82	69	58	50	44	39	
1.84	2.39	3.04	3.76	4.56	5.44	6.29	7.30	8.46	9.70	
108	94	84	75	68	63	58	54	50	47	
1.48	1.92	2.44	2.99	3.61	4.34	5.08	5.91	6.73	7.67	
175	134	106	86	71	60	51	44	38	34	
1.61	2.09	2.66	3.28	3.96	4.75	5.56	6.46	7.34	8.50	
94	82	73	66	60	55	50	47	44	41	
1.29	1.68	2.13	2.64	3.20	3.81	4.40	5.17	5.95	6.73	
263	202	159	129	107	90	76	66	57	50	
1.61	2.10	2.66	3.28	3.98	4.75	5.52	6.46	7.34	8.33	
140	123	109	98	89	82	76	70	66	61	
1.28	1.68	2.12	2.62	3.16	3.79	4.46	5.13	5.95	6.67	
222	170	134	109	90	76	64	56	48	43	
1.43	1.87	2.36	2.92	3.53	4.23	4.90	5.77	6.51	7.55	
118	104	92	83	75	69	64	59	55	52	
1.14	1.50	1.89	2.34	2.81	3.36	3.96	4.56	5.22	5.99	
333	255	202	163	135	113	97	83	73	64	
1.43	1.87	2.37	2.91	3.53	4.19	4.95	5.70	6.61	7.49	
178	156	138	124	113	104	96	89	83	78	
1.15	1.50	1.89	2.33	2.82	3.37	3.96	4.59	5.26	5.99	
274	210	166	134	111	93	80	69	60	53	
1.29	1.68	2.13	2.62	3.17	3.77	4.46	5.18	5.94	6.78	
146	128	114	102	93	85	79	73	68	64	
1.03	1.34	1.71	2.09	2.54	3.01	3.56	4.11	4.71	5.38	
411	315	249	202	167	140	119	103	90	79	
1.29	1.68	2.13	2.63	3.18	3.78	4.43	5.16	5.94	6.74	
219	192	171	154	140	128	118	110	102	96	
1.03	1.34	1.71	2.11	2.55	3.03	3.55	4.13	4.71	5.38	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**R-19-7 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Meter of Width				Allowable Fiber Stress 157.9 MPa					
b=1/4" 8.346 b=3/8" 7.660 b=1/4" 27.39 b=3/8" 25.20									
U—Uniform Load, kPa			C—Concentrated Load, N/mm of width				D—Deflection, mm		
Bearing Bar Size mm (inches)	Section Modulus	Moment Inertia per. ft.(304.8mm) width	Approx. Wt*(Kg)/ Sq. meter	Span in Millimeters					
				305	457	610	762	914	
25 x 6.4  (1 x 1/4)	5 700	72 400	40	U	222	99	55	36	25
				Du	0.53	1.18	2.09	3.33	4.78
				C	34	23	17	14	11
				Dc	0.42	0.96	1.69	2.72	3.68
25 x 9.5  (1 x 3/8)	7 870	99 900	53	U	306	136	77	49	34
				Du	0.53	1.18	2.12	3.28	4.71
				C	47	31	23	19	16
				Dc	0.42	0.94	1.66	2.67	3.88
32 x 6.4  (1 1/4 x 1/4)	8 910	141 400	49	U	347	154	87	56	39
				Du	0.42	0.94	1.69	2.65	3.82
				C	53	35	26	21	18
				Dc	0.34	0.75	1.33	2.09	3.09
32 x 9.5  (1 1/4 x 3/8)	12 290	195 100	65	U	478	213	120	77	53
				Du	0.42	0.94	1.69	2.64	3.76
				C	73	49	36	29	24
				Dc	0.34	0.76	1.33	2.09	2.98
38 x 6.4  (1 1/2 x 1/4)	12 820	244 300	58	U	499	222	125	80	56
				Du	0.35	0.79	1.41	2.19	3.17
				C	76	51	38	30	25
				Dc	0.28	0.63	1.12	1.72	2.48
38 x 9.5  (1 1/2 x 3/8)	17 700	337 100	77	U	689	307	172	110	77
				Du	0.35	0.79	1.40	2.18	3.16
				C	105	70	53	42	35
				Dc	0.28	0.63	1.13	1.75	2.52
44 x 6.4  (1 3/4 x 1/4)	17 460	388 000	66	U	679	303	170	109	76
				Du	0.30	0.68	1.20	1.88	2.71
				C	104	69	52	41	35
				Dc	0.24	0.54	0.97	1.48	2.19
44 x 9.5  (1 3/4 x 3/8)	24 090	535 400	89	U	937	417	234	150	104
				Du	0.30	0.67	1.20	1.87	2.69
				C	143	95	71	57	48
				Dc	0.24	0.54	0.96	1.50	2.17
51 x 6.4  (2 x 1/4)	22 800	579 100	75	U	887	395	222	142	99
				Du	0.26	0.59	1.05	1.64	2.37
				C	135	90	68	54	45
				Dc	0.21	0.47	0.85	1.31	1.88
51 x 9.5  (2 x 3/8)	31 460	799 200	101	U	1224	545	306	196	136
				Du	0.26	0.59	1.05	1.64	2.36
				C	187	125	93	75	62
				Dc	0.21	0.47	0.84	1.32	1.88
57 x 6.4  (2 1/4 x 1/4)	28 860	824 600	83	U	1123	500	281	180	125
				Du	0.23	0.52	0.94	1.46	2.10
				C	171	114	86	69	57
				Dc	0.19	0.42	0.75	1.18	1.68
57 x 9.5  (2 1/4 x 3/8)	39 820	1 138 000	113	U	1549	690	387	248	173
				Du	0.23	0.52	0.93	1.46	2.11
				C	236	158	118	95	79
				Dc	0.19	0.42	0.75	1.17	1.68

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
18	14	11	9	7	6	5	5	4	3	
6.40	8.47	10.68	13.31	15.14	18.41	21.11	28.42	29.94	29.05	
10	8	8	7	6	6	5	5	5	4	
5.33	6.36	9.06	10.87	12.39	16.10	17.05	21.31	26.20	25.42	
25	19	15	12	10	9	7	6	5	5	
6.44	8.33	10.56	12.86	15.67	20.01	21.41	24.72	27.12	35.09	
13	12	10	9	8	8	7	7	6	6	
5.02	6.91	8.21	10.13	11.97	15.56	17.30	21.62	22.78	27.63	
28	22	17	14	11	10	8	7	6	5	
5.09	6.82	8.45	10.60	12.18	15.71	17.29	20.37	23.00	24.79	
15	13	12	11	10	9	8	8	7	7	
4.09	5.29	6.96	8.74	10.57	12.37	13.97	17.46	18.78	22.78	
39	30	24	19	16	13	11	10	9	7	
5.14	6.74	8.65	10.42	12.84	14.80	17.23	21.09	25.00	25.15	
21	18	16	15	13	12	11	10	10	9	
4.15	5.31	6.72	8.64	9.96	11.95	13.92	15.81	19.44	21.22	
41	31	25	20	17	14	12	10	9	8	
4.32	5.56	7.19	8.76	10.89	12.72	15.01	16.84	19.96	22.96	
22	19	17	15	14	13	12	11	10	10	
3.47	4.47	5.71	6.90	8.57	10.34	12.12	13.89	15.52	18.83	
56	43	34	28	23	19	16	14	12	11	
4.27	5.59	7.09	8.89	10.68	12.51	14.50	17.09	19.29	22.87	
30	26	23	21	19	18	16	15	14	13	
3.43	4.44	5.59	7.00	8.42	10.37	11.71	13.73	15.75	17.74	
55	43	34	27	22	19	16	14	12	11	
3.65	4.86	6.16	7.45	8.88	10.88	12.60	14.85	16.76	19.88	
30	26	23	21	19	17	16	15	14	13	
2.98	3.85	4.86	6.08	7.32	8.51	10.18	11.93	13.69	15.42	
77	59	46	38	31	26	22	19	17	15	
3.70	4.83	6.04	7.60	9.07	10.78	12.56	14.60	17.21	19.64	
41	36	32	29	26	24	22	20	19	18	
2.95	3.87	4.90	6.09	7.26	8.71	10.14	11.53	13.46	15.47	
72	56	44	36	29	25	21	18	16	14	
3.20	4.24	5.34	6.65	7.84	9.59	11.08	12.79	14.97	16.95	
39	34	30	27	25	23	21	19	18	17	
2.60	3.38	4.25	5.24	6.45	7.72	8.95	10.12	11.79	13.51	
100	77	60	49	41	34	29	25	22	19	
3.22	4.22	5.28	6.56	8.03	9.45	11.09	12.87	14.92	16.67	
53	47	42	37	34	31	29	27	25	23	
2.56	3.38	4.31	5.20	6.36	7.54	8.96	10.42	11.87	13.24	
92	70	55	45	37	31	27	23	20	18	
2.87	3.72	4.69	5.84	7.03	8.35	10.01	11.48	13.14	15.30	
49	43	38	34	31	29	26	24	23	21	
2.29	3.00	3.78	4.63	5.62	6.83	7.78	8.98	10.58	11.72	
127	97	77	62	51	43	37	32	28	24	
2.87	3.74	4.76	5.83	7.02	8.39	9.94	11.57	13.33	14.79	
68	59	53	47	43	39	36	34	32	30	
2.30	2.98	3.82	4.64	5.65	6.66	7.81	9.22	10.67	12.13	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**R-19-7 HEAVY DUTY RIVETED STEEL GRATING**

				b=1/4"	8.348	b=3/8"	7.680		
				b=1/4"	27.39	b=3/8"	25.20		
U—Uniform Load, kPa			C—Concentrated Load, N/mm of width				D—Deflection, mm		
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia per. ft.(304.8mm) width	Approx. Wt.(Kg)/ Sq. meter	Span in Millimeters					
				305	457	610	762		
64 x 6.4  (2½ x ¼)	35 600	1 131 000	92	U	1386	617	347	222	154
				Du	0.21	0.47	0.84	1.31	1.89
				C	211	141	106	85	71
				Dc	0.17	0.38	0.68	1.06	1.52
64 x 9.5  (2½ x ¾)	49 200	1 561 000	125	U	1913	852	478	306	213
				Du	0.21	0.47	0.84	1.31	1.89
				C	292	195	146	117	97
				Dc	0.17	0.38	0.67	1.05	1.51
76 x 6.4  (3 x ¼)	51 300	1 955 000	109	U	1996	889	499	320	222
				Du	0.18	0.39	0.70	1.10	1.57
				C	304	203	152	122	102
				Dc	0.14	0.31	0.56	0.88	1.27
76 x 9.5  (3 x ¾)	70 800	2 697 000	149	U	2754	1227	689	441	307
				Du	0.18	0.39	0.70	1.09	1.58
				C	420	280	210	168	140
				Dc	0.14	0.31	0.56	0.88	1.26
89 x 6.4  (3½ x ¼)	69 800	3 104 000	127	U	2717	1210	679	435	303
				Du	0.15	0.34	0.60	0.94	1.35
				C	414	277	207	166	138
				Dc	0.12	0.27	0.48	0.75	1.08
89 x 9.5  (3½ x ¾)	96 400	4 283 000	173	U	3749	1670	937	601	417
				Du	0.15	0.34	0.60	0.94	1.35
				C	572	382	286	229	191
				Dc	0.12	0.27	0.48	0.75	1.08
102 x 6.4  (4 x ¼)	91 200	4 633 000	144	U	3548	1581	887	568	395
				Du	0.13	0.30	0.53	0.82	1.18
				C	541	361	271	217	181
				Dc	0.11	0.24	0.42	0.66	0.95
102 x 9.5  (4 x ¾)	125 900	6 393 000	197	U	4897	2181	1224	784	545
				Du	0.13	0.30	0.53	0.82	1.18
				C	747	498	373	299	249
				Dc	0.11	0.24	0.42	0.66	0.94
114 x 6.4  (4½ x ¼)	155 400	6 597 000	161	U	4491	2000	1123	719	500
				Du	0.12	0.26	0.47	0.73	1.05
				C	685	457	342	274	229
				Dc	0.09	0.21	0.37	0.58	0.84
114 x 9.5  (4½ x ¾)	159 300	9 103 000	221	U	6197	2760	1549	993	690
				Du	0.12	0.26	0.47	0.73	1.05
				C	945	631	473	378	315
				Dc	0.09	0.21	0.37	0.58	0.84
127 x 6.4  (5 x ¼)	142 500	9 049 000	179	U	5544	2470	1386	888	617
				Du	0.11	0.24	0.42	0.66	0.94
				C	846	564	423	338	282
				Dc	0.08	0.19	0.34	0.52	0.76
127 x 9.5  (5 x ¾)	196 600	12 487 000	244	U	7651	3408	1913	1226	852
				Du	0.11	0.24	0.42	0.66	0.94
				C	1167	779	583	467	389
				Dc	0.08	0.19	0.34	0.53	0.76

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

**LOAD  
TABLES  
(METRIC)**

U—Uniform Load, kPa				C—Concentrated Load, N/mm of Width Span in Millimeters				D—Deflection,mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
113	87	68	56	46	39	33	28	25	22	
2.57	3.37	4.23	5.30	6.37	7.66	8.92	10.19	11.98	13.64	
60	53	47	42	38	35	33	30	28	26	
2.05	2.69	3.41	4.17	5.02	6.01	7.20	8.18	9.39	10.58	
156	120	95	77	63	53	45	39	34	30	
2.57	3.37	4.28	5.28	6.32	7.54	8.81	10.28	11.80	13.47	
83	73	65	58	53	49	45	42	39	36	
2.05	2.69	3.41	4.18	5.08	6.10	7.12	8.30	9.48	10.61	
163	125	99	80	66	56	47	41	36	31	
2.15	2.80	3.56	4.38	5.29	6.36	7.35	8.63	9.98	11.12	
87	76	68	61	55	51	47	44	41	38	
1.72	2.24	2.85	3.51	4.21	5.07	5.94	6.95	7.96	8.95	
225	172	136	110	91	77	65	56	49	43	
2.15	2.79	3.55	4.37	5.28	6.34	7.36	8.54	9.84	11.18	
120	105	93	84	76	70	65	60	56	53	
1.72	2.24	2.83	3.50	4.21	5.04	5.95	6.86	7.88	9.04	
222	170	134	109	90	76	64	55	48	43	
1.84	2.40	3.04	3.76	4.54	5.44	6.30	7.29	8.38	9.71	
118	104	92	83	75	69	64	59	55	52	
1.47	1.93	2.43	3.01	3.61	4.32	5.09	5.87	6.72	7.71	
306	235	185	150	124	104	89	77	67	59	
1.84	2.40	3.04	3.75	4.53	5.39	6.35	7.40	8.48	9.66	
163	143	127	114	104	95	88	82	76	72	
1.47	1.92	2.43	2.99	3.63	4.31	5.07	5.91	6.73	7.73	
290	222	175	142	118	99	84	72	63	56	
1.61	2.10	2.66	3.28	3.99	4.75	5.54	6.40	7.37	8.47	
155	135	120	108	98	90	83	77	72	68	
1.29	1.68	2.12	2.62	3.16	3.77	4.42	5.13	5.89	6.75	
400	307	242	196	162	136	116	100	87	77	
1.61	2.10	2.66	3.28	3.97	4.72	5.54	6.44	7.37	8.44	
213	187	166	149.	136	125	115	107	100	93	
1.28	1.68	2.13	2.62	3.18	3.80	4.44	5.16	5.93	6.69	
367	281	222	180	149	125	106	92	80	70	
1.43	1.87	2.37	2.92	3.54	4.21	4.91	5.74	6.57	7.44	
196	171	152	137	125	114	105	98	91	86	
1.15	1.49	1.89	2.33	2.83	3.36	3.93	4.58	5.23	6.00	
506	388	306	248	205	172	147	127	110	97	
1.43	1.87	2.36	2.92	3.53	4.20	4.94	5.74	6.55	7.47	
270	236	210	189	172	158	146	135	126	118	
1.14	1.49	1.89	2.33	2.82	3.37	3.96	4.58	5.25	5.96	
453	347	274	222	184	154	131	113	99	87	
1.29	1.68	2.13	2.63	3.18	3.78	4.42	5.14	5.93	6.74	
242	212	188	169	154	141	130	121	113	106	
1.03	1.35	1.70	2.10	2.54	3.03	3.55	4.13	4.74	5.39	
625	479	378	306	253	213	181	156	136	120	
1.29	1.68	2.13	2.62	3.17	3.79	4.43	5.14	5.90	6.74	
334	292	259	234	212	195	180	167	156	146	
1.03	1.34	1.70	2.11	2.54	3.03	3.56	4.13	4.74	5.38	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**R-37-5 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/A <sub>r</sub> +b)					b=1/4"	4.683	b=3/8"	4.465	No. Bars/Meter of Width					b=1/4"	15.36	b=3/8"	14.65
U—Uniform Load, kPa				C—Concentrated Load, N/mm of width								D—Deflection, mm					
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia	Approx. W <sub>t</sub> *(Kg/ Sq. meter)	Span in Millimeters													
					305	457	610	762	914								
<b>25 x 6.4</b>  (1 x 1/4")	3 200	40 600	25	U	124	55	31	20	14	Du	0.52	1.17	2.10	3.30	4.77		
				C	19	13	9	8	6	Dc	0.42	0.97	1.60	2.77	3.58		
				U	178	79	44	29	20	Du	0.53	1.18	2.08	3.34	4.77		
				C	27	18	14	11	9	Dc	0.42	0.94	1.74	2.66	3.76		
<b>32 x 6.4</b>  (1 1/4 x 1/4")	5 000	79 300	30	U	194	87	49	31	22	Du	0.42	0.95	1.70	2.61	3.84		
				C	30	20	15	12	10	Dc	0.34	0.76	1.36	2.13	3.06		
				U	278	124	70	45	31	Du	0.42	0.95	1.70	2.65	3.78		
				C	42	28	21	17	14	Dc	0.33	0.75	1.33	2.11	2.99		
<b>38 x 6.4</b>  (1 1/2 x 1/4")	7 190	137 100	35	U	280	125	70	45	31	Du	0.35	0.79	1.40	2.20	3.13		
				C	43	28	21	17	14	Dc	0.28	0.62	1.10	1.74	2.48		
				U	400	178	100	64	45	Du	0.35	0.79	1.40	2.18	3.18		
				C	61	41	31	24	20	Dc	0.28	0.63	1.14	1.72	2.47		
<b>44 x 6.4</b>  (1 3/4 x 1/4")	9 790	217 600	40	U	381	170	95	61	42	Du	0.30	0.68	1.20	1.88	2.67		
				C	58	39	29	23	19	Dc	0.24	0.54	0.96	1.48	2.12		
				U	545	243	136	87	61	Du	0.30	0.68	1.20	1.87	2.71		
				C	83	55	42	33	28	Dc	0.24	0.54	0.97	1.49	2.18		
<b>51 x 6.4</b>  (2 x 1/4")	12 790	324 900	44	U	498	222	124	80	55	Du	0.26	0.59	1.05	1.65	2.34		
				C	76	51	38	30	25	Dc	0.21	0.48	0.84	1.30	1.87		
				U	712	317	178	114	79	Du	0.26	0.59	1.05	1.64	2.35		
				C	109	72	54	43	36	Dc	0.21	0.47	0.84	1.30	1.88		
<b>57 x 6.4</b>  (2 1/4 x 1/4")	16 190	462 600	49	U	630	281	157	101	70	Du	0.23	0.53	0.93	1.46	2.10		
				C	96	64	48	38	32	Dc	0.19	0.42	0.75	1.15	1.68		
				U	901	401	225	144	100	Du	0.23	0.52	0.93	1.46	2.09		
				C	137	92	69	55	46	Dc	0.19	0.42	0.75	1.17	1.69		

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

**LOAD  
TABLES  
(METRIC)**

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
10	8	6	5	4	3	3	3	2	2	
6.33	8.63	10.39	13.18	15.42	16.41	22.58	30.40	26.69	34.53	
5	5	4	4	3	3	3	3	3	2	
4.75	7.08	8.08	11.07	11.04	14.35	18.23	22.79	28.02	22.66	
15	11	9	7	6	5	4	4	3	3	
6.64	8.30	10.90	12.90	16.18	19.12	21.05	28.34	27.99	36.21	
8	7	6	5	5	5	4	4	4	3	
5.31	6.93	8.47	9.68	12.87	16.72	17.00	21.25	26.12	23.77	
16	12	10	8	6	5	5	4	3	3	
5.19	6.63	8.87	10.80	11.84	14.00	19.27	20.75	20.50	26.52	
8	7	7	6	5	5	5	4	4	4	
3.89	5.08	7.24	8.50	9.42	12.25	15.56	15.56	19.13	23.20	
23	17	14	11	9	8	7	6	5	4	
5.22	6.57	8.68	10.38	12.42	15.66	18.86	21.77	23.89	24.72	
12	11	9	8	8	7	7	6	6	5	
4.08	5.58	6.51	7.93	10.54	11.99	15.23	16.32	20.06	20.28	
23	18	14	11	9	8	7	6	5	4	
4.32	5.75	7.18	8.59	10.28	12.96	15.61	18.02	19.77	20.46	
12	11	9	9	8	7	7	6	6	5	
3.38	4.62	5.38	7.38	8.72	9.92	12.61	13.51	16.60	16.79	
33	25	20	16	13	11	9	8	7	6	
4.33	5.59	7.17	8.74	10.38	12.46	14.03	16.80	19.35	21.46	
17	15	14	12	11	10	9	9	8	8	
3.35	4.40	5.86	6.88	8.39	9.91	11.33	14.17	15.48	18.78	
31	24	19	15	13	11	9	8	7	6	
3.66	4.83	6.14	7.38	9.35	11.22	12.64	15.13	17.43	19.33	
17	15	13	12	11	10	9	8	8	7	
3.01	3.96	4.90	6.20	7.55	8.93	10.21	11.34	13.94	14.80	
45	34	27	22	18	15	13	11	10	9	
3.72	4.79	6.10	7.57	9.05	10.70	12.76	14.54	17.41	20.27	
24	21	18	17	15	14	13	12	11	10	
2.97	3.88	4.74	6.14	7.20	8.74	10.31	11.90	13.40	14.78	
41	31	25	20	16	14	12	10	9	8	
3.25	4.18	5.41	6.59	7.71	9.57	11.29	12.67	15.01	17.26	
22	19	17	15	14	13	12	11	10	9	
2.61	3.36	4.29	5.19	6.44	7.77	9.12	10.45	11.68	12.75	
58	45	35	29	24	20	17	15	13	11	
3.21	4.24	5.30	6.68	8.09	9.56	11.18	13.29	15.16	16.60	
31	27	24	22	20	18	17	16	14	14	
2.57	3.34	4.24	5.32	6.43	7.53	9.03	10.63	11.43	13.86	
51	39	31	25	21	18	15	13	11	10	
2.84	3.69	4.71	5.79	7.11	8.64	9.91	11.57	12.89	15.16	
27	24	21	19	17	16	15	14	13	12	
2.25	2.98	3.72	4.62	5.49	6.72	8.00	9.34	10.66	11.94	
74	56	45	36	30	25	21	18	16	14	
2.88	3.71	4.78	5.83	7.10	8.39	9.70	11.20	13.11	14.84	
39	34	31	27	25	23	21	20	18	17	
2.27	2.96	3.84	4.59	5.65	6.75	7.84	9.33	10.32	11.82	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

**LOAD  
TABLES  
(METRIC)**

**R-37-5 HEAVY DUTY RIVETED STEEL GRATING**

No. Bars/Ft. of Width (12/Ar+b) No. Bars/Meter of Width				b=1/4" 4.683 b=3/8" 4.465 b=1/4" 15.36 b=3/8" 14.65					
U—Uniform Load, kPa				C—Concentrated Load, N/mm of width			D—Deflection,mm		
Bearing Bar Size mm (inches)	Section Modulus per. ft.(304.8mm) width	Moment Inertia	Approx. Wt*(Kg)/ Sq. meter	Span in Millimeters					
				305	457	610	762	914	
64 x 6.4 (2½ x ¼")	19 980	635 000	54	U	778	346	194	125	87
				Du	0.21	0.47	0.84	1.32	1.90
				C	119	79	59	47	40
				Dc	0.17	0.38	0.67	1.04	1.53
64 x 9.5 (2½ x ¾")	28 580	907 000	75	U	1112	495	278	178	124
				Du	0.21	0.47	0.84	1.31	1.89
				C	170	113	85	68	57
				Dc	0.17	0.38	0.68	1.05	1.52
76 x 6.4 (3 x ¼")	28 780	1 096 000	64	U	1120	499	280	179	125
				Du	0.18	0.39	0.70	1.09	1.58
				C	171	114	85	68	57
				Dc	0.14	0.32	0.56	0.87	1.26
76 x 9.5 (3 x ¾")	41 200	1 568 000	89	U	1601	713	400	257	178
				Du	0.18	0.39	0.70	1.10	1.57
				C	244	163	122	98	81
				Dc	0.14	0.31	0.56	0.88	1.25
89 x 6.4 (3½ x ¼")	39 200	1 741 000	74	U	1524	679	381	244	170
				Du	0.15	0.34	0.60	0.94	1.35
				C	232	155	116	93	78
				Dc	0.12	0.27	0.48	0.75	1.09
89 x 9.5 (3½ x ¾")	56 000	2 490 000	103	U	2180	971	545	349	243
				Du	0.15	0.34	0.60	0.94	1.35
				C	332	222	166	133	111
				Dc	0.12	0.27	0.48	0.75	1.08
102 x 6.4 (4 x ¼")	51 200	2 599 000	84	U	1991	887	498	319	222
				Du	0.13	0.30	0.53	0.82	1.18
				C	304	203	152	122	101
				Dc	0.11	0.24	0.42	0.66	0.94
102 x 9.5 (4 x ¾")	73 200	3 717 000	117	U	2847	1268	712	456	317
				Du	0.13	0.30	0.53	0.82	1.18
				C	434	290	217	174	145
				Dc	0.11	0.24	0.42	0.66	0.95
114 x 6.4 (4½ x ¼")	64 750	3 700 000	93	U	2519	1122	630	404	281
				Du	0.12	0.26	0.47	0.73	1.05
				C	384	256	192	154	128
				Dc	0.09	0.21	0.37	0.58	0.84
114 x 9.5 (4½ x ¾")	92 600	5 292 000	131	U	3603	1605	901	577	401
				Du	0.12	0.26	0.47	0.73	1.05
				C	549	367	275	220	183
				Dc	0.09	0.21	0.37	0.58	0.84
127 x 6.4 (5 x ¼")	79 900	5 076 000	103	U	3110	1385	778	498	346
				Du	0.11	0.24	0.42	0.66	0.94
				C	474	317	237	190	158
				Dc	0.08	0.19	0.34	0.53	0.75
127 x 9.5 (5 x ¾")	114 300	7 260 000	145	U	4448	1981	1112	713	495
				Du	0.11	0.24	0.42	0.66	0.94
				C	678	453	339	272	226
				Dc	0.08	0.19	0.34	0.53	0.75

NOTE: When serrated grating is specified, the depth of grating required for specific load will be the next depth greater than that shown in these tables.

LOAD  
TABLES  
(METRIC)

U—Uniform Load, kPa			C—Concentrated Load, N/mm of Width Span in Millimeters					D—Deflection, mm		
1067	1219	1372	1524	1676	1829	1981	2134	2286	2438	
64	49	38	31	26	22	18	16	14	12	
2.59	3.38	4.21	5.23	6.42	7.70	8.67	10.38	11.96	13.26	
34	30	26	24	22	20	18	17	16	15	
2.07	2.72	3.36	4.25	5.18	6.12	7.00	8.27	9.56	10.88	
91	70	55	45	37	31	26	23	20	17	
2.58	3.38	4.26	5.31	6.38	7.59	8.76	10.43	11.94	13.13	
48	42	38	34	31	28	26	24	23	21	
2.04	2.66	3.43	4.21	5.11	5.99	7.07	8.16	9.61	10.65	
91	70	55	45	37	31	27	23	20	18	
2.13	2.80	3.53	4.39	5.28	6.28	7.53	8.63	9.89	11.51	
49	43	38	34	31	28	26	24	23	21	
1.72	2.26	2.84	3.48	4.23	4.96	5.85	6.75	7.96	8.81	
131	100	79	64	53	45	38	33	29	25	
2.15	2.79	3.54	4.37	5.29	6.37	7.41	8.66	10.02	11.18	
70	61	54	49	44	41	38	35	33	31	
1.72	2.24	2.82	3.51	4.19	5.08	5.98	6.89	7.98	9.10	
125	95	75	61	50	42	36	31	27	24	
1.85	2.39	3.03	3.75	4.50	5.36	6.32	7.33	8.40	9.66	
66	58	52	47	42	39	36	33	31	29	
1.46	1.92	2.45	3.03	3.61	4.35	5.10	5.85	6.75	7.66	
178	136	108	87	72	61	52	45	39	34	
1.84	2.39	3.05	3.74	4.53	5.44	6.38	7.44	8.49	9.57	
95	83	74	67	60	55	51	48	44	42	
1.47	1.92	2.44	3.02	3.60	4.29	5.06	5.95	6.70	7.76	
163	125	98	80	66	55	47	41	35	31	
1.61	2.11	2.65	3.30	3.98	4.70	5.53	6.49	7.30	8.36	
87	76	67	61	55	51	47	43	41	38	
1.29	1.68	2.11	2.64	3.16	3.81	4.46	5.11	5.98	6.73	
233	178	141	114	94	79	67	58	51	45	
1.61	2.10	2.67	3.28	3.96	4.72	5.51	6.42	7.44	8.49	
124	109	97	87	79	72	67	62	58	54	
1.29	1.69	2.14	2.63	3.18	3.76	4.45	5.15	5.92	6.68	
206	158	125	101	83	70	60	51	45	39	
1.43	1.87	2.38	2.92	3.51	4.20	4.96	5.67	6.59	7.39	
110	96	85	77	70	64	59	55	51	48	
1.15	1.49	1.88	2.34	2.83	3.36	3.94	4.59	5.23	5.97	
294	226	178	144	119	100	85	74	64	56	
1.43	1.87	2.36	2.91	3.52	4.20	4.91	5.75	6.55	7.42	
157	137	122	110	100	92	85	79	73	69	
1.14	1.49	1.89	2.34	2.82	3.38	3.96	4.61	5.23	6.00	
254	195	154	125	103	86	74	64	55	49	
1.29	1.68	2.13	2.64	3.18	3.76	4.46	5.19	5.87	6.77	
136	119	105	95	86	79	73	68	63	59	
1.03	1.35	1.70	2.10	2.53	3.02	3.55	4.13	4.71	5.35	
363	278	220	178	147	124	105	91	79	70	
1.29	1.68	2.13	2.62	3.17	3.79	4.42	5.16	5.90	6.76	
194	170	151	136	123	113	104	97	91	85	
1.03	1.35	1.71	2.11	2.53	3.02	3.54	4.12	4.75	5.39	

\*Weight depends on panel width, cross bar selection, mill tolerance and manufacturing tolerance.

## GLOSSARY TERMS

# GLOSSARY

Commonly used

**ANCHOR** — A device by which grating is attached to its supports.

**BAND** — A flat welded to a side or end of a grating panel, or along the line of a cutout, and extending neither above nor below the bearing bars.

**Load-carrying Band:** A band used to transfer the load between bearing bars.

**Trim Band:** A band which carries no load, but is used chiefly to improve appearance and stability.

**BEARING BARS** — Load-carrying members extending in the direction of the grating span.

**BEARING BAR CENTERS** — The distance center to center of the bearing bars.

**CLEAR OPENING** — The distance between faces of bearing bars in a rectangular grating, or between a reticuline bar and a bearing bar in a riveted grating.

**CROSS BARS** — The connecting bars which extend across the bearing bars, usually perpendicular to them. They may be bent into a corrugated or sinuous pattern and, where they intersect the bearing bars, are welded, forged or mechanically locked to them.

**CROSS BAR CENTERS** — The distance center to center of the cross bars.

**CURVED CUT** — A cutout following a curved pattern.

**CUTOUT** — An area of grating removed to clear an obstruction or to permit pipes, ducts, columns, etc. to pass through the grating.

**FINISH** — The coating, usually paint or galvanizing, which is applied to the grating.

**GRATING** — An open grid assembly of metal bars, in which the bearing bars, running in one direction, are spaced by rigid attachment to cross bars running perpendicular to them or by reticuline bars extending between them.

**HINGED PANELS** — Grating panels which are hinged to their supports or to other grating parts.

**LENGTH** — Refer to *Span of Grating*.

**PRESSURE-LOCKED GRATING** — Grating in which the cross bars are mechanically locked to the bearing bars at their intersections by deforming or swaging the metal.

**RETICULINE BAR** — A sinuously bent connecting bar extending between two adjacent bearing bars, alternately contacting and being riveted to each.

**REVERSIBLE GRATING** — Grating so constructed that it may be installed either side up, with no difference in appearance or carrying capacity.

**RIVET CENTERS** — The distance center to center of rivets along one bearing bar.

**RIVETED GRATING** — Grating composed of straight bearing bars and reticuline bars, which are joined, at their contact points, by riveting.

**SERRATED GRATING** — Grating which has the top surfaces of the bearing bars or cross bars, or both, notched.

**SPAN OF GRATING** — The distance between points of grating support, or the dimension of the bearing bars in this direction.

**STRAIGHT CUT** — That portion of the cut edge or cutout of a grating which follows a straight line.

**SWAGING** — A method of altering the cross-sectional shape of a metal bar by pressure applied through dies.

**TOEPLATE** — A flat bar attached flat against the outer edge of a grating and projecting above the top surface of grating to form a lip or curb.

**WELDED GRATING** — Grating in which the bearing bars and the cross bars are joined at all of their intersections by either a resistance weld or conventional hand welding.

A resistance weld is obtained by the heat produced by the resistance of the material to the flow of electric current causing the material to become plastic. At this point the pressure on the cross bar is rapidly increased causing the cross bar to penetrate the bearing bar so that they are fused together.

**WIDTH** — The overall dimension of grating panel, measured perpendicular to the bearing bars.

